




# **EQUITONE** system

**construction details**

EQUITONE with concealed fixings

New Zealand



# Table of contents

General information	3
Ventilation	4
Components	5
EQUITONE concealed fixing system with flexible air barrier	10
EQUITONE concealed fixing system with rigid air barrier	26



# General information

This document provides generic construction details for EQUITONE façade systems to assist with the design of EQUITONE façade.

Construction details in this document have been independently certified for the purpose of compliance with Clause E2, External moisture, of the New Zealand Building Code within the scope of E2/VM1 and E2/VM2 for EQUITONE façade systems with the recommended pliable and rigid weather barrier, respectively, as described in the 'General components'.

The weatherproofing performance of any project specific detail or application that is different from or not included in the construction details of this document shall be evaluated by the project engineer or consultant.

It is the responsibility of the project designer, architect and engineer to ensure that the information and construction details provided in this document are appropriate for the intended application.

Cladding support frame and its connection to substructure shall be designed by the project engineer in accordance with the relevant standards. The support frame maximum deflection under the influence of load shall be limited to  $\text{Span}/250$ .

The support frame, fixings, flashings and the like shall be of adequate corrosion resistance appropriate to the corrosivity category of the project location.

Flashings and capping shall be designed with respect to project wind loading, relevant standards and regulations.

This document is not designed to serve as an installation guide, and is intended to be used in conjunction with other relevant technical and installation documents.

Construction details contained in this document are not to a specific scale, and are for illustration purposes only.

The information in this document is correct at the time of issuing. However, due to our committed program of continuous material and system development we reserve the right to amend or alter the information contained therein without prior notice. Please contact your local EQUITONE sales organisation to ensure you have the most current version.

This document is supplied in good faith and no liability can be accepted for any loss or damage resulting from its use. All the content of this document is © Copyright of Etex Group. All rights reserved.

This document is protected by International copyright laws. Reproduction and distribution in whole or in part without prior written permission is strictly prohibited. Cedral and logos are trademarks of Etex NV or an affiliate thereof. Any use without authorisation is strictly prohibited and may violate trademark laws.

# Ventilation

A ventilated façade is a kind of two stage construction, an inner structure with a protective outer skin, and the cladding panel or rainscreen. A ventilated façade consists of an insulated and weathertight structure, a ventilated cavity formed with a cladding support frame, and the cladding panel.


Allowance for adequate ventilation is paramount in ensuring a successful EQUITONE façade. Ventilated façades provide a number of added benefits to the building and its occupants. These may include but are not limited to the following:

- Positive contribution to energy savings
- Minimises thermal bridges
- Assists with condensation management
- Reduces thermal movement of the structure and cladding support frame
- Dissipates radiant heat
- Increases acoustic performance of the external wall
- Provides an effective drainage path for any moisture passing the cladding skin
- Eliminates the need for exposed caulking and sealant, therefore reducing maintenance requirements
- Assists with Keeping the weather barrier dry and healthy
- Architectural design freedom
- Provides opportunities for concealing external services such as downpipes within the cavity
- Proven to be a more sustainable and healthier façade construction

Air must be allowed to enter the cavity from bottom of the façade, window head, soffit, slab junctions, and the like, and exit from top of the façade, capping, window sill, slab and soffit interfaces, and the like.

All air inlets and outlets are protected against entry of birds and vermin into the cavity with a corrosion resistant perforated profile (angle).

The perforated angle should be of maximum 0.9mm in thickness, where placed between the cladding panel and support frame, and be of a minimum 50% open area with aperture size of maximum 3mm to 5mm. The perforations must be kept open and unobstructed to maintain drainage and ventilation of the cavity. The perforated angle shall be positioned to allow an adequate drip edge to the cladding panel.

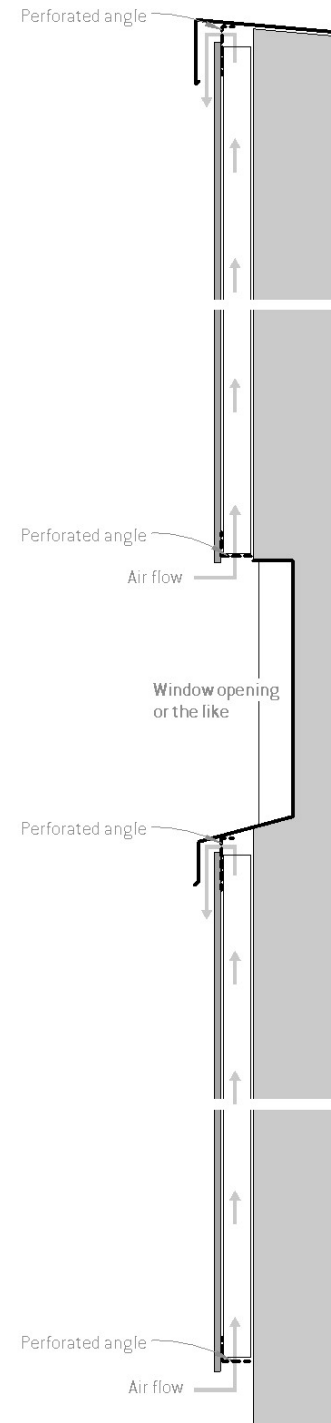

# Components

## Material



EQUITONE [tectiva]



EQUITONE [lines]




EQUITONE [natura]





EQUITONE [pictura]

### Maximum available panel sizes

EQUITONE [tectiva] 8 mm thick  
EQUITONE [lines] 10 mm thick

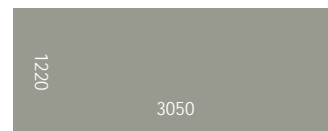

EQUITONE [natura] 8 and 12 mm thick  
EQUITONE [natura] PRO 8 and 12 mm thick  
EQUITONE [pictura] 8 and 12 mm thick

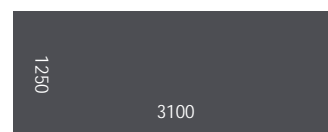


## Panel fixings

### SFS TUF-S

Stainless Steel 316 grade concealed fixings

#### Notes

The application of the SFS TUF-S fixings shall be in strict accordance with SFS guidelines and recommendations.  
SFS TUF-S is available in various sizes suiting different panel thicknesses.  
SFS TUF-S panel edge distance: 50 – 110 mm

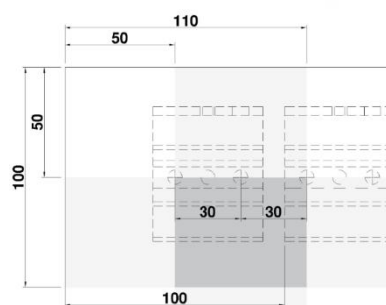

# Components

## Compressible EPDM gasket Tesa® 61103

A compressible closed-cell EPDM gasket used for sealing interfaces with flashings and the like.

Minimum width:

- 9mm where a narrow strip is required as specified on the construction details
- 48mm where located on vertical joints as specified on the construction details



## Expanding foam gasket pro clima CONTEGA® FIDEN EXO

A pre-compressed sealing tape used to seal interfaces with window joineries and the like as specified on the construction details.

The required tape size depends on the gap which needs to be sealed. Refer to pro clima CONTEGA® FIDEN EXO datasheet to determine the required tape size.



## Baffle

Black coated aluminium baffle used to close and form expressed panel horizontal joint.



## Vertical expressed joint profile

NV3 black coated aluminium T joint profile used to close and form expressed vertical panel joint.



## Weather resistive barrier option 1 Flexible air barrier (pliable membrane)

EQUITONE façade systems have been certified with pro clima SOLITEX EXTASANA® pliable membrane to E2/VM1 for the purpose of compliance with Clause E2 of the NZBC for the following scope:

- Serviceability wind pressure: Up to  $\pm 1515\text{Pa}$
- Ultimate wind pressure: Up to  $\pm 2500\text{Pa}$
- Building height: Up to 10m

pro clima SOLITEX EXTASANA® shall be applied in accordance with pro clima SOLITEX EXTASANA® installation guidelines and relevant standards.



# Components

## Weather resistive barrier option 2 Rigid air barrier


Where a rigid air barrier is required the ADHERO version of pro clima SOLITEX EXTASANA® may be used with 6mm Kalsi (RigidBacker) fibre cement sheeting.

EQUITONE façade systems have been certified with pro clima SOLITEX EXTASANA® AHERO and Kalsi to E2/VM2 for the purpose of compliance with Clause E2 of the NZBC for the following scope:

Serviceability wind pressure: Up to  $\pm 2250\text{Pa}$

Building height: Up to 25m

pro clima SOLITEX EXTASANA® ADHERO shall be applied in accordance with pro clima SOLITEX EXTASANA® ADHERO installation guidelines and relevant standards.

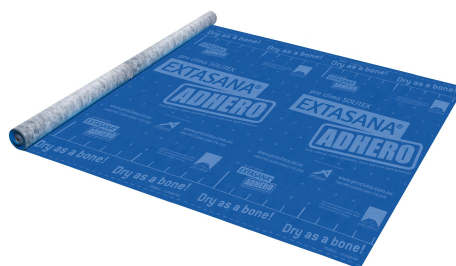

## Flashing tape pro clima TESCON EXTORA®

A pressure sensitive adhesive tape for overlaps and end laps used with both weather resistive barrier options.



## Sill tape pro clima TESCON EXTOSEAL®

A flexible tape for use around window and door openings, used with both weather resistive barrier options.



## Sealing tape pro clima TESCON® NAIDECK mono patch

A single-sided adhesive nail or screw sealing adhesive used with both weather resistive barrier options.



## Foil tape pro clima TESCON® ADHISO WS

A pure aluminium tape for wet seal connections to TESCON EXTOSEAL® and EXTORA® and SOLITEX EXTASANA®.



## Grommet pro clima ROFLEX and KALFEX

pro clima ROFLEX is used to seal pipe and pro clima KALFLEX for cable penetrations. pro clima ROFLEX and KALFEX are used with both weather resistive barrier options.



# Support frame

EQUITONE may be fixed to NVELOPE NV3 thermally broken aluminium bracketry framing system.

Support frame shall be of adequate corrosion resistance required for the project.

Structure and support frame shall be designed to relevant standards including, but not limited to, the following:

- AS/NZS 1664.1 – Aluminium structures
- AS/NZS 4600 – Cold-formed steel structures
- NZS 3404 – Steel structures
- NZS 3604 – Timber framed buildings



## Thermal isolator gasket

Used to minimise thermal bridging, and to separate aluminium from steel or concrete.



## Bracket

NVELOPE aluminium brackets are available in two sizes, ie single and double, with various depths to suit a wide range of cavity widths from approx. 50 to 300mm.

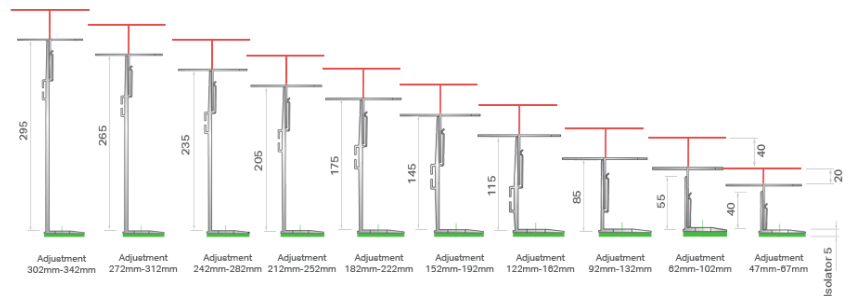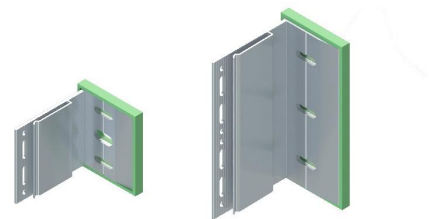

## Vertical rail (profile)

NVELOPE aluminium vertical L rails  
Minimum face width of L rail: 40 mm



## Vertical aluminium Omega (top hat) or Z rail

These may substitute NVELOPE bracket and vertical L rails.






# Support frame

## Horizontal rail

NV3 aluminium horizontal rail onto which EQUITONE panel is mounted.




## Hanger

NV3 aluminium hangers are fixed onto rear of EQUITONE panel with SFS TUF-S concealed fixings. There are two types of hanger – adjustable & static. Adjustable hanger only applies to the top row panel fixings (hangers).




## Isometric view of the assembly

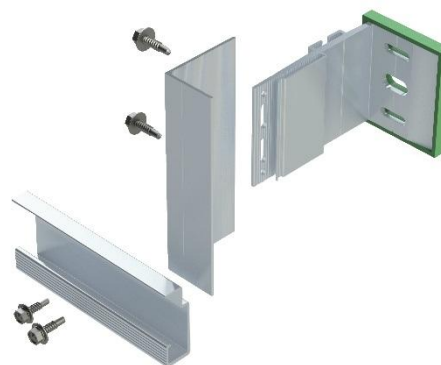

## Notes

Support frame and its connection to substructure shall be designed by project engineer in accordance with the relevant standards. The application of NVELOPE system shall be in accordance with its supplier's recommendations and guidelines. Refer to NVELOPE and EQUITONE brochure for detailed information on NVELOPE components and their available sizes and options.

# EQUITONE system

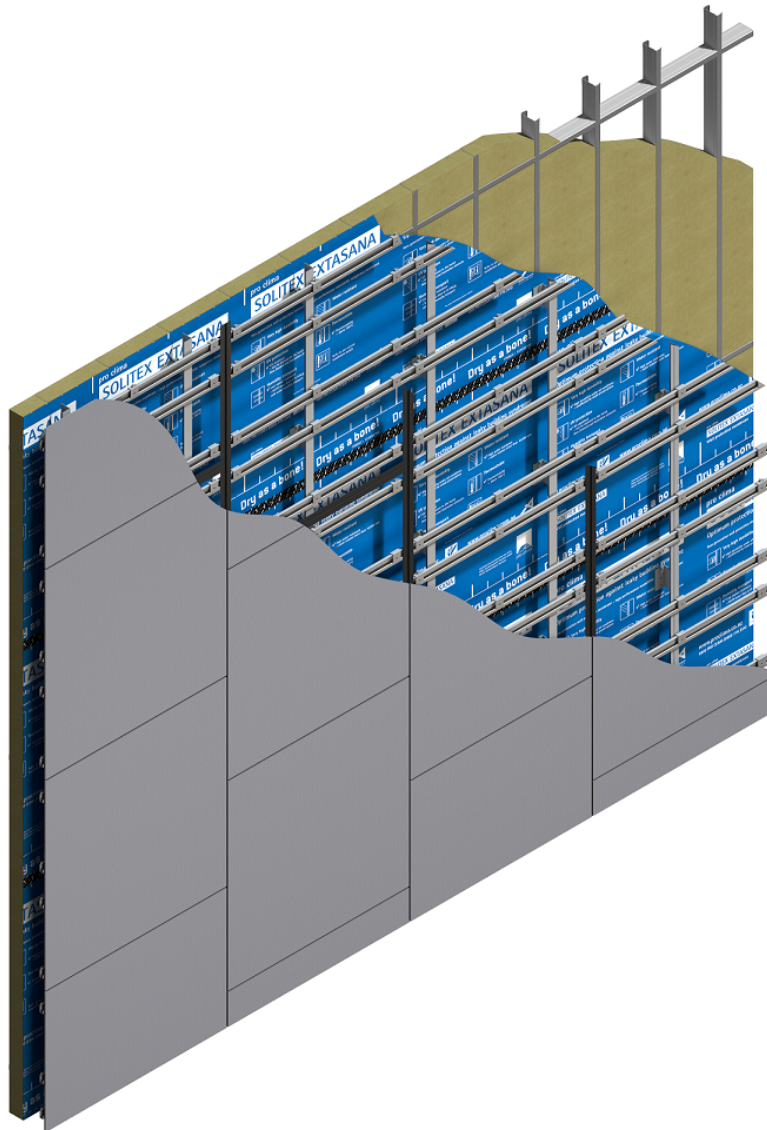

flexible air barrier (pliable membrane)  
concealed fixing system

# Drawings index

Detail	Figure	Page
Baffled horizontal joint	1	12
Baffled horizontal joint junction with vertical joint - Elevation	2	12
Vertical joint - Detail 1	3	13
Vertical joint - Detail 2	4	13
Intermediate panel fixings connection	5	13
Horizontal control joint	6	14
Vertical control joint	7	14
Flush window - Head and sill	8	15
Flush window - Jamb	9	15
Recessed window - Head and sill	10	16
Recessed window jamb - Option 1	11	16
Recessed window jamb - Option 2	12	16
Meter box - Section	13	17
Meter box - Plan view - Detail 1	14	17
Meter box - Plan view - Detail 2	15	17
Isometric view of window/meter box opening - Tape application	16	18
Soffit junction	17	18
Base detail	18	19
Base detail - Covered area	19	19
Base detail - Balcony	20	19
Junction with other materials - flush detail	21	20
Junction with other materials, eaves or the like - recessed detail	22	20
Exposed concrete slab or beam - Cladding flush	23	21
Exposed concrete slab or beam - Cladding recessed	24	21
External corner	25	22
Abutment	26	22
Internal corner	27	22
Pipe penetration - Plan view	28	23
Pipe penetration - Elevation	29	23
Pipe penetration - Section	30	23
Capping - Detail 1	31	24
Capping - Detail 2	32	24
Parapet junction - Section	33	24
Parapet junction - Plan view	34	25
Corrosion resistant saddle flashing	35	25

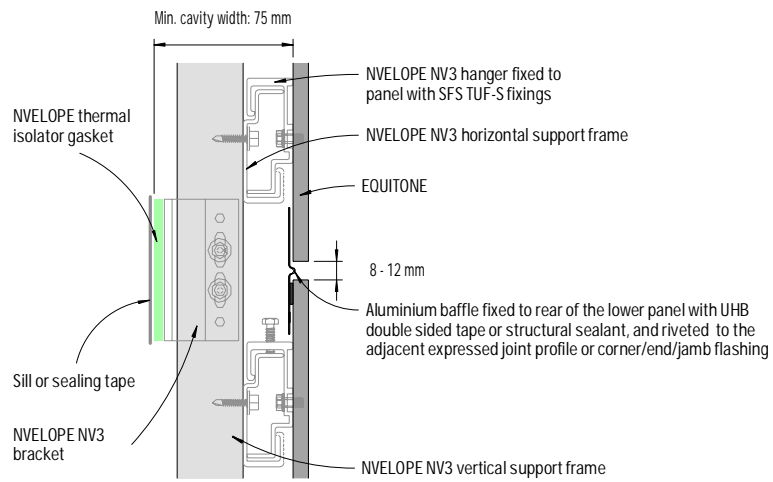


Figure 1: Baffled horizontal joint  
(Not suitable for EQUITONE [materia])

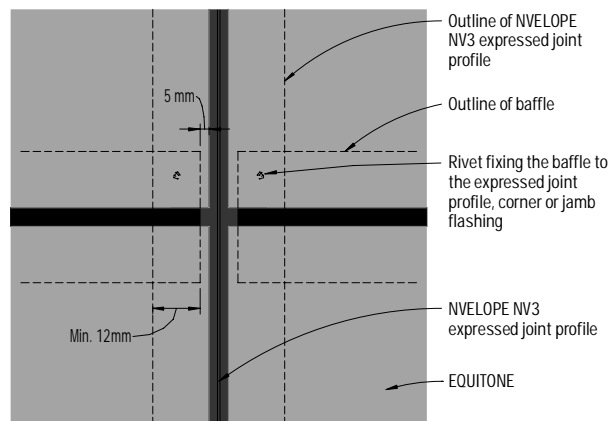


Figure 2: Baffled horizontal joint  
junction with vertical joint - Elevation

Notes

- 1) The length of NVELOPE NV3 vertical and horizontal rail, and expressed joint profile must NOT exceed 3,150mm.

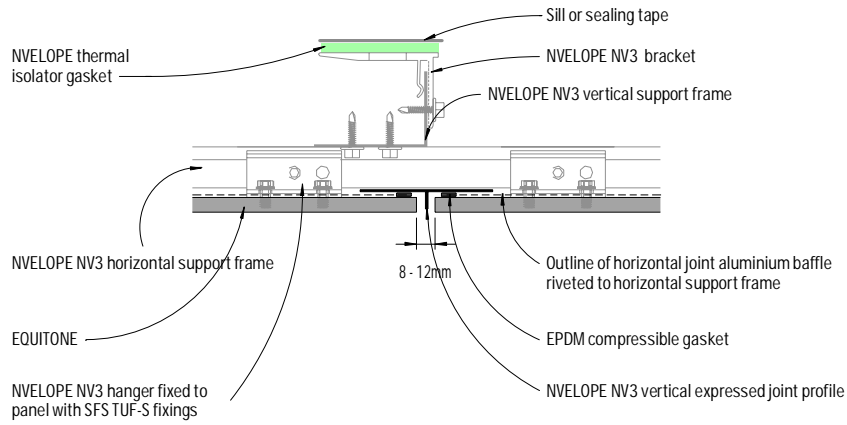


Figure 3: Vertical joint - Detail 1

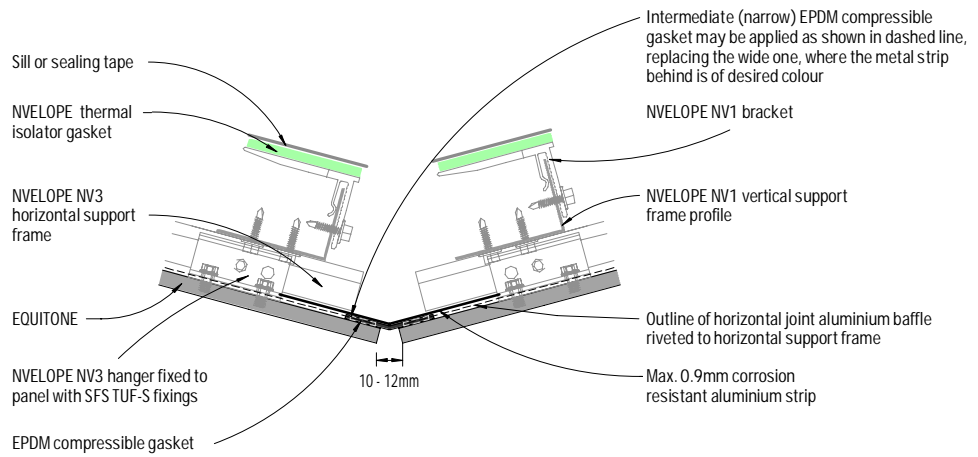


Figure 4: Vertical joint - Detail 2

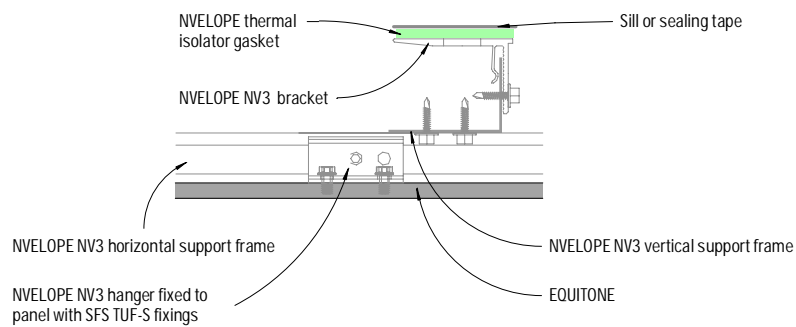


Figure 5: Intermediate panel fixings connection

Notes

- 1) The deflection of NVELOPE NV3 vertical expressed joint profile (as included in Figure 3) and any aluminium strip located at the vertical joint (as included in Figure 4) shall be limited to an extent ensuring the seal along the vertical joint is maintained with respect to project wind loading.
- 2) The aluminium strip should be fixed ONLY to one of the support frame profiles (either left or right) where allowance for horizontal and/or vertical movement of the cladding frame is required.
- 3) For EQUITONE [material] refer to EQUITONE construction details with Kalsi RigidBacker.

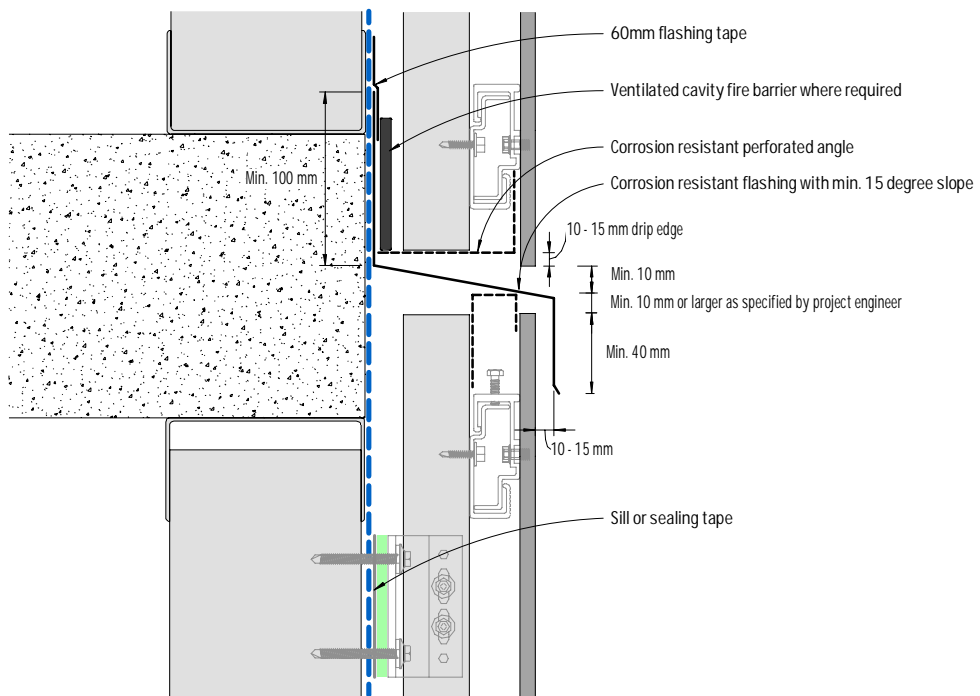


Figure 6: Horizontal control joint

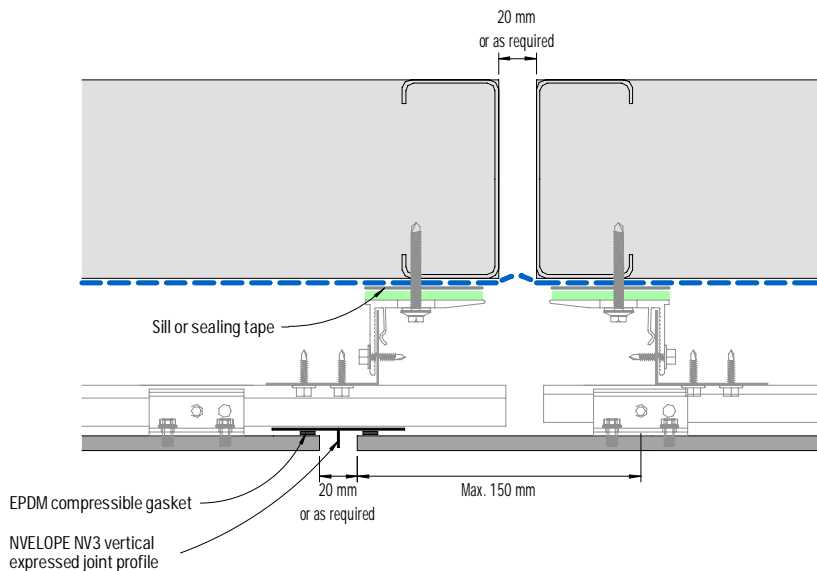


Figure 7: Vertical control joint

Notes

- 1) Support frame profiles must NOT be fixed crossing over a control joint.
- 2) The deflection of NVELOPE NV3 vertical expressed joint profile shall be limited to an extent ensuring the seal along the vertical joint is maintained with respect to project wind loading.
- 3) Allowance for movement at the location of any control joint must be made in the cladding and its support frame design and installation. Panel must NOT be fixed bridging over any control joint.
- 4) Corrosion resistant perforated angle shall be of max. thickness of 0.9mm where located between panel and support frame, and be of min. 50% open area with aperture size of 3-5mm.

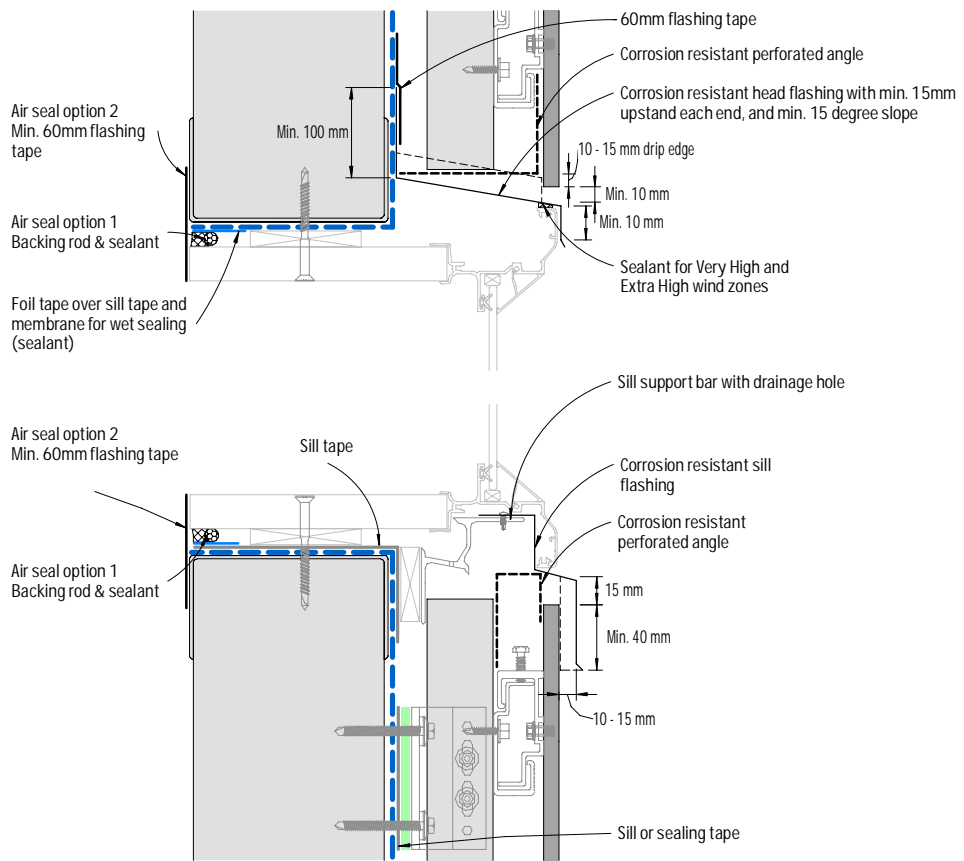


Figure 8: Flush window - Head and sill

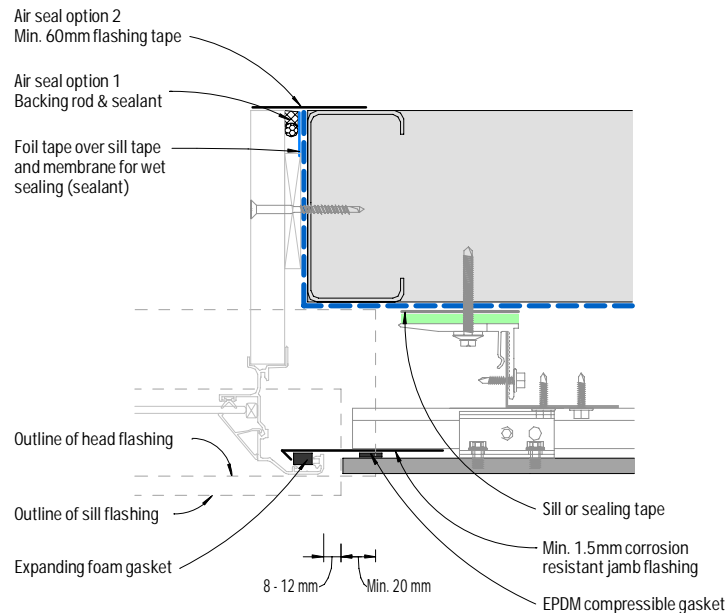


Figure 9: Flush window - Jamb

Notes

- 1) ONLY sealant compatible with the foil tape should be used. Should any sealant be intended to be used directly on the flashing and/or sill tape it must be confirmed with its manufacturer to ensure compatibility with these tapes in accordance with the relevant standards.
- 2) Corrosion resistant perforated angle shall be of max. thickness of 0.9mm where located between panel and support frame, and be of min. 50% open area with aperture size of 3-5mm.

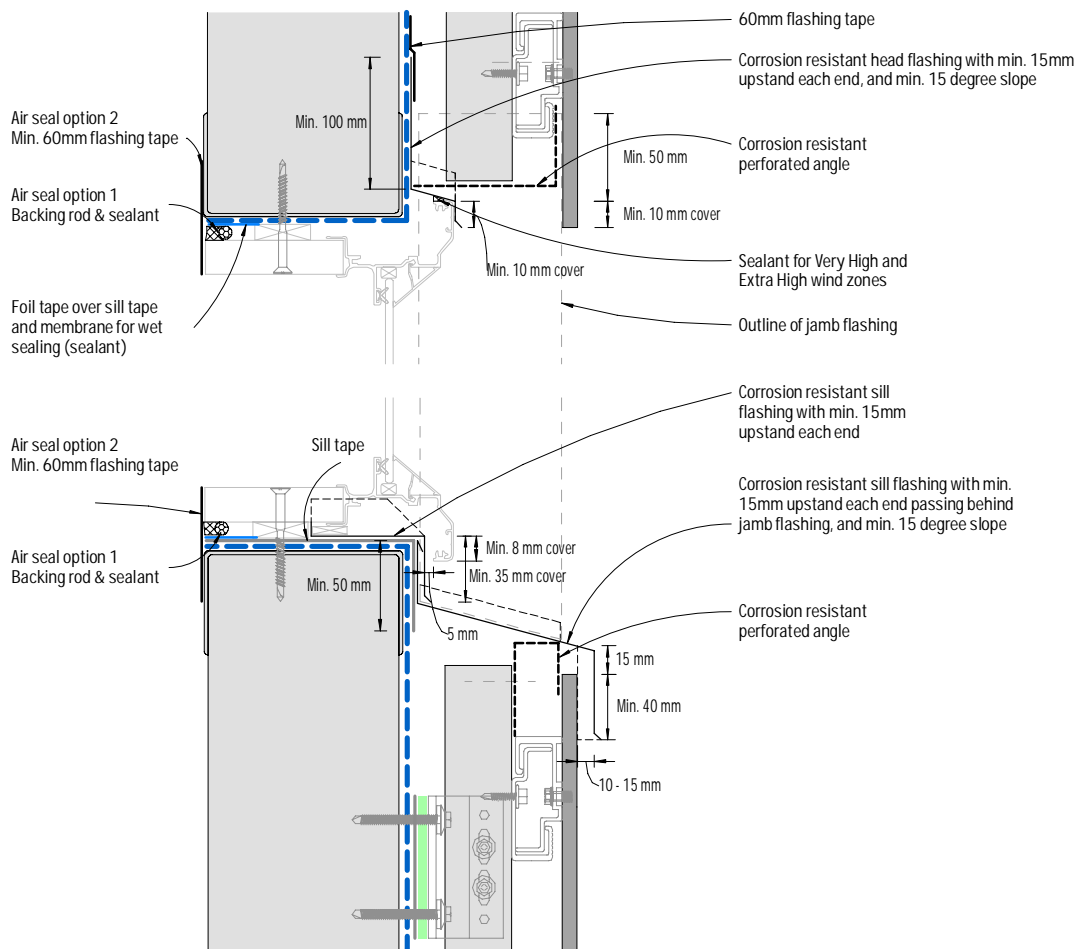


Figure 10: Recessed window - Head and sill

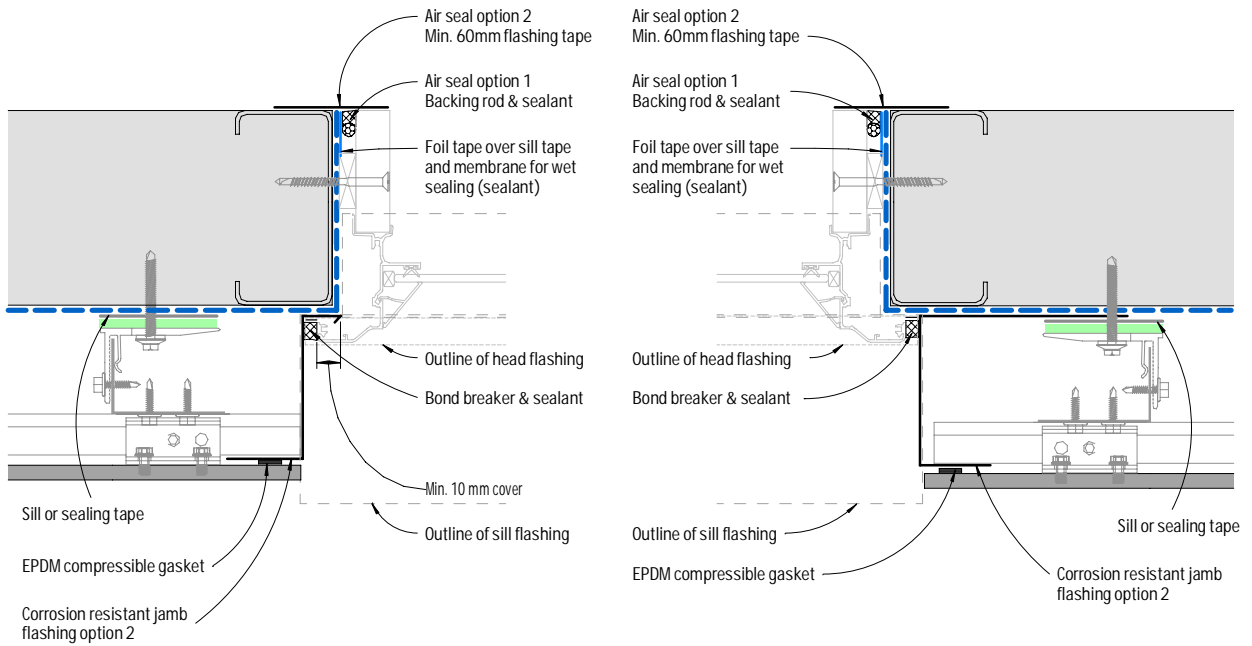


Figure 11: Recessed window jamb - Option 1

Figure 12: Recessed window jamb - Option 2

Notes

- 1) ONLY sealant compatible with the foil tape should be used. Should any sealant be intended to be used directly on the flashing and/or sill tape it must be confirmed with its manufacturer to ensure compatibility with these tapes in accordance with the relevant standards.
- 2) Corrosion resistant perforated angle shall be of max. thickness of 0.9mm where located between panel and support frame, and be of min. 50% open area with aperture size of 3-5mm.



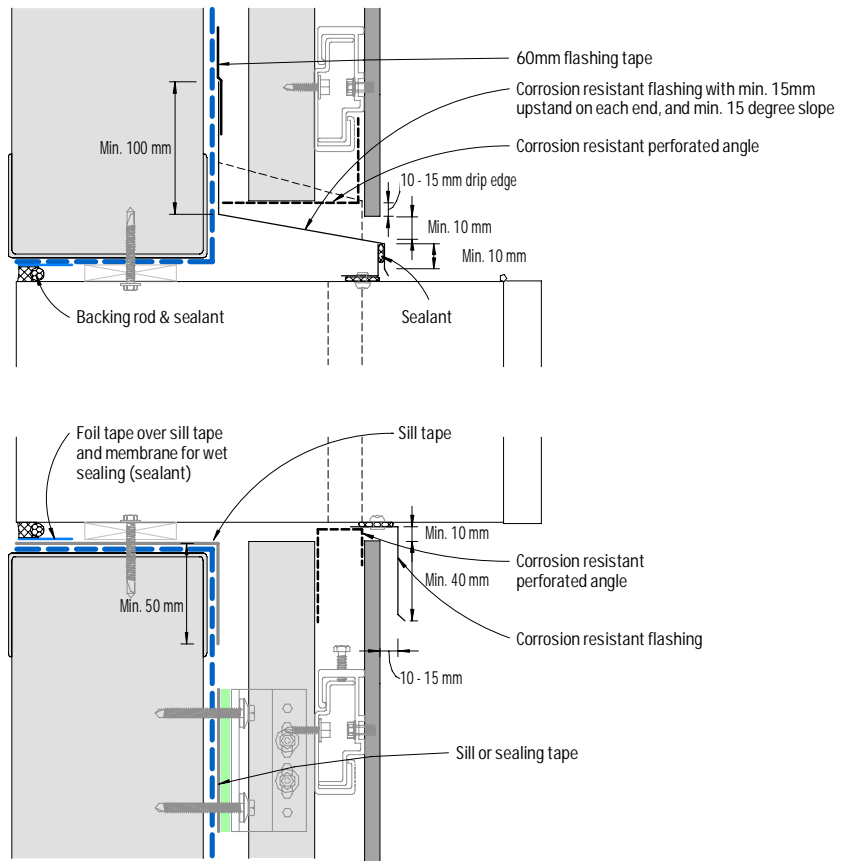


Figure 13: Meter box - Section

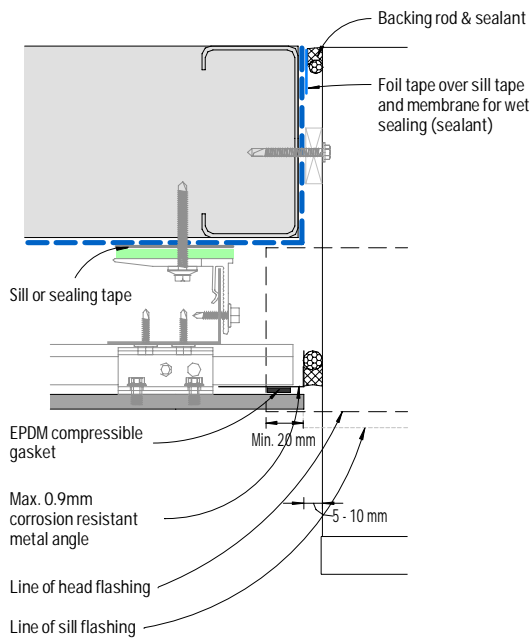


Figure 14: Meter box - Plan view - Detail 1

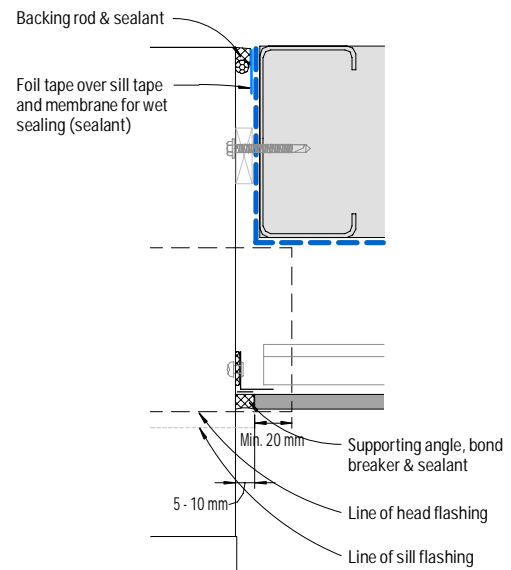


Figure 15: Meter box - Plan view - Detail 2

Notes

- 1) ONLY sealant compatible with the foil tape should be used. Should any sealant be intended to be used directly on the flashing and/or sill tape it must be confirmed with its manufacturer to ensure compatibility with these tapes in accordance with the relevant standards.
- 2) Corrosion resistant perforated angle shall be of max. thickness of 0.9mm where located between panel and support frame, and be of min. 50% open area with aperture size of 3-5mm.

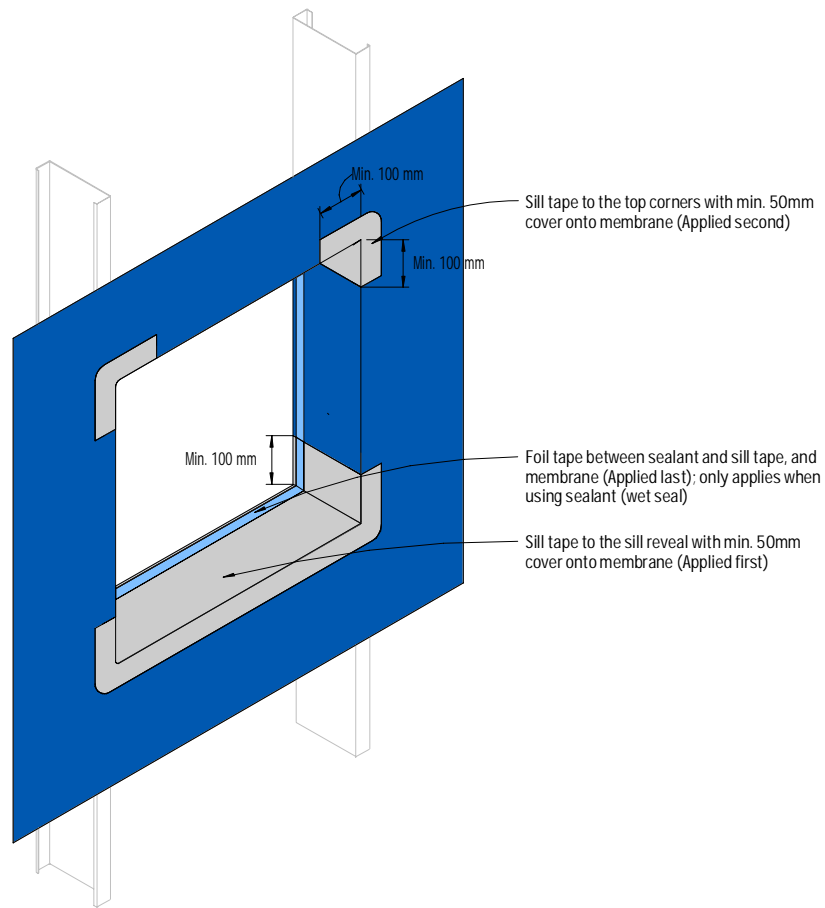


Figure 16: Isometric view of window/meter box opening - Tape application

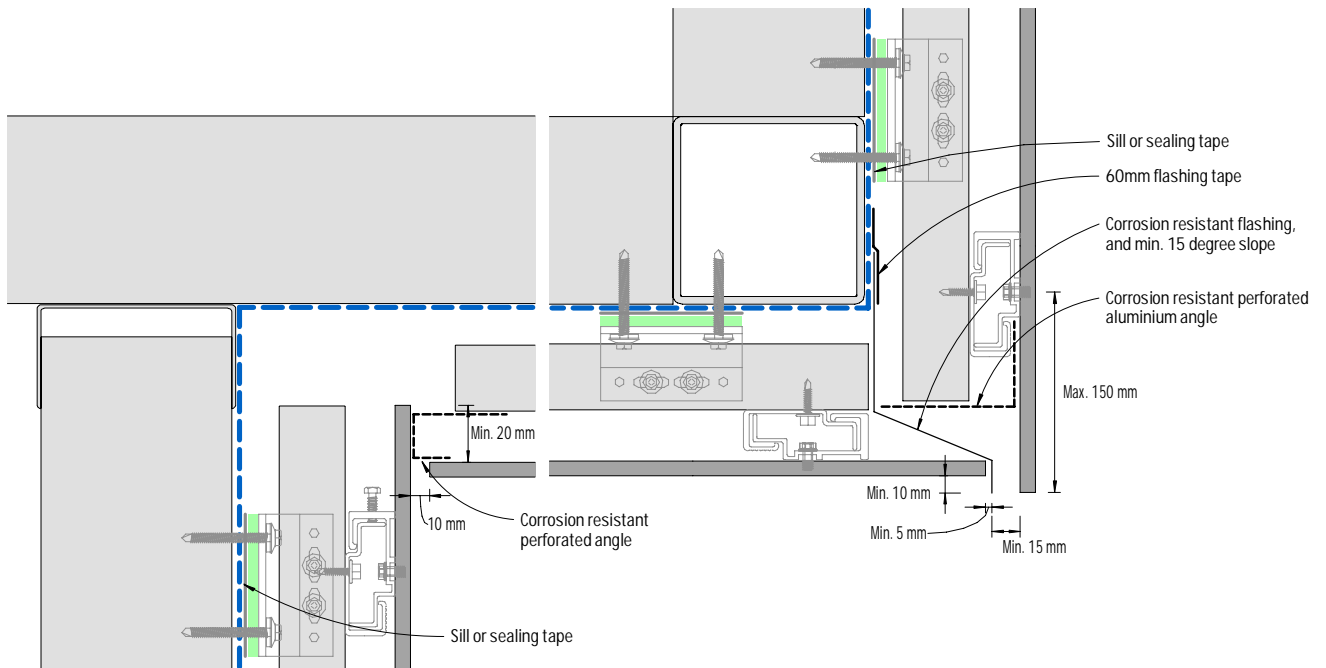


Figure 17: Soffit junction

Notes

- 1) ONLY sealant compatible with the foil tape should be used. Should any sealant be intended to be used directly on the flashing and/or sill tape it must be confirmed with its manufacturer to ensure compatibility with these tapes in accordance with the relevant standards.
- 2) Support frame profiles must NOT be fixed crossing over a control joint.
- 3) Corrosion resistant perforated angle shall be of max. thickness of 0.9mm where located between panel and support frame, and be of min. 50% open area with aperture size of 3-5mm.

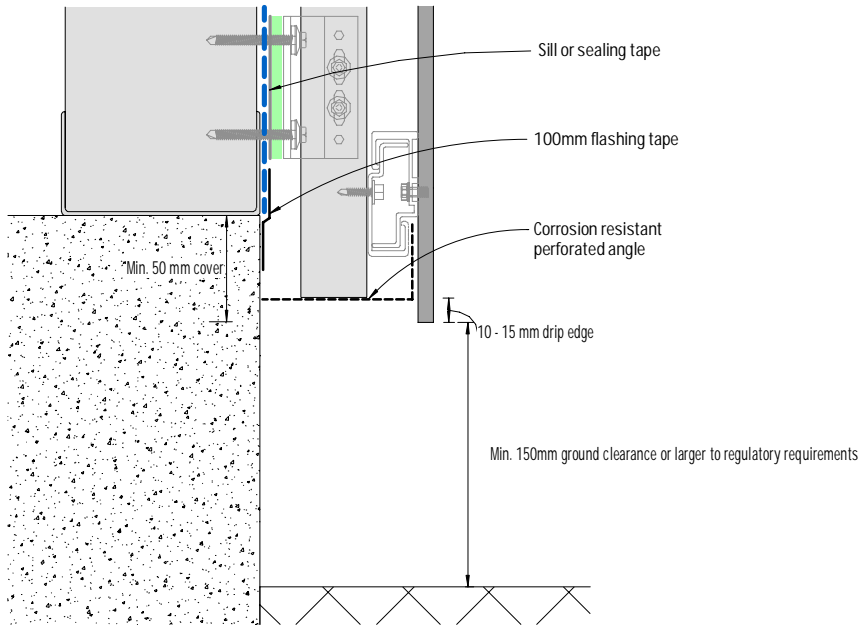


Figure 18: Base detail

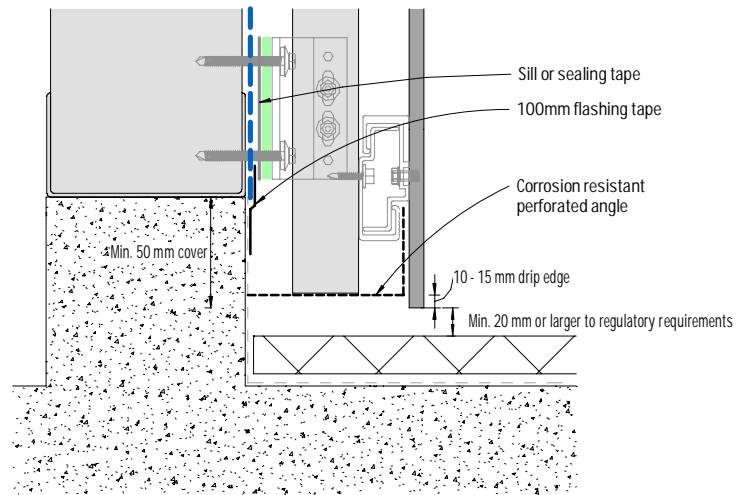


Figure 19: Base detail - Covered area

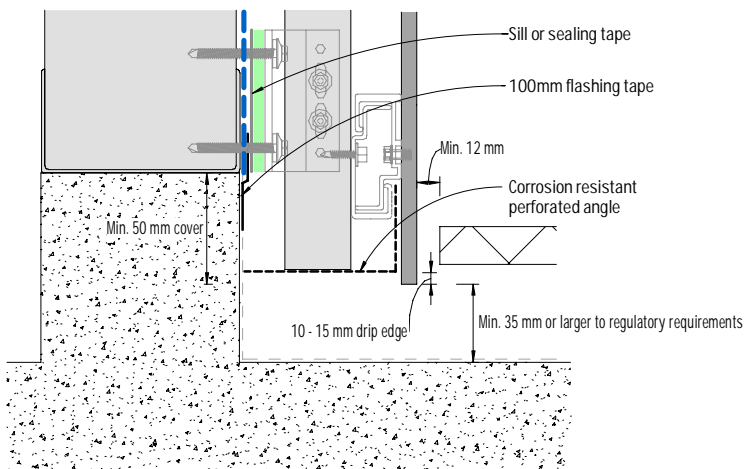


Figure 20: Base detail - Balcony

Notes

1) For **EQUITONE [materia]**, minimum ground clearance is **300mm**.

2) Corrosion resistant perforated angle shall be of max. thickness of 0.9mm where located between panel and support frame, and be of min. 50% open area with aperture size of 3-5mm.

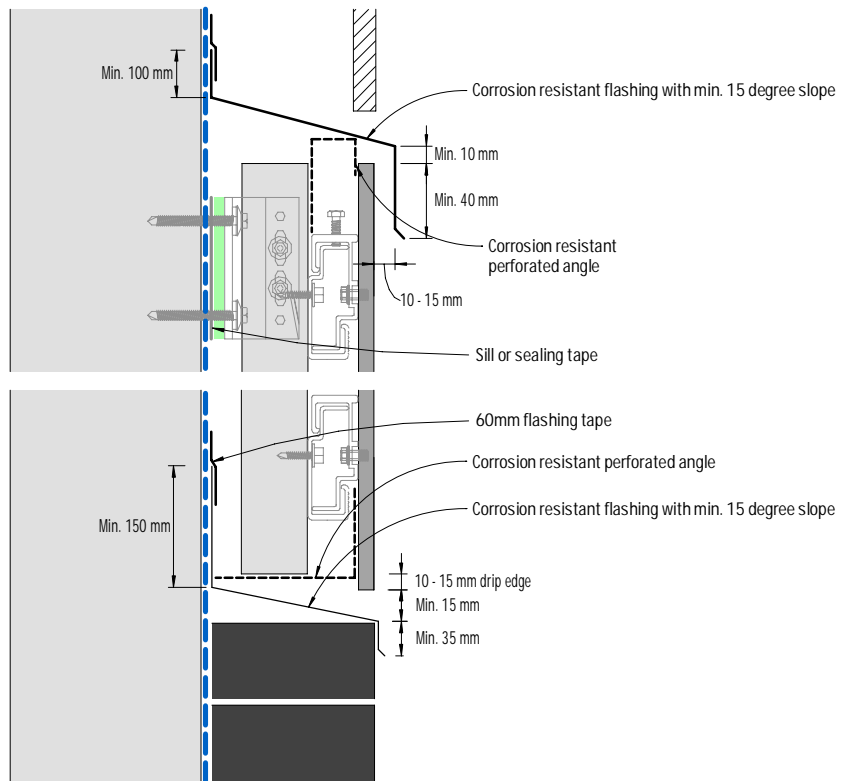


Figure 21: Junction with other materials - flush detail

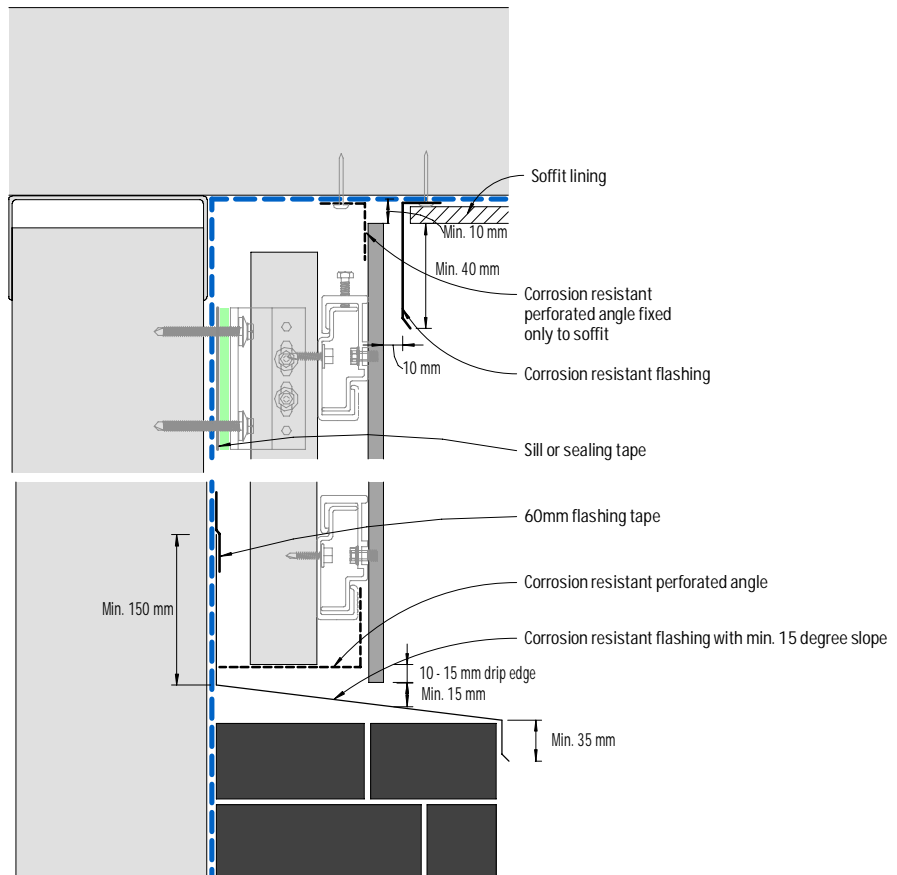


Figure 22: Junction with other materials, eaves or the like - recessed detail

Notes

- 1) Support frame profiles must NOT be fixed crossing over a control joint.
- 2) Corrosion resistant perforated angle shall be of max. thickness of 0.9mm where located between panel and support frame, and be of min. 50% open area with aperture size of 3-5mm.

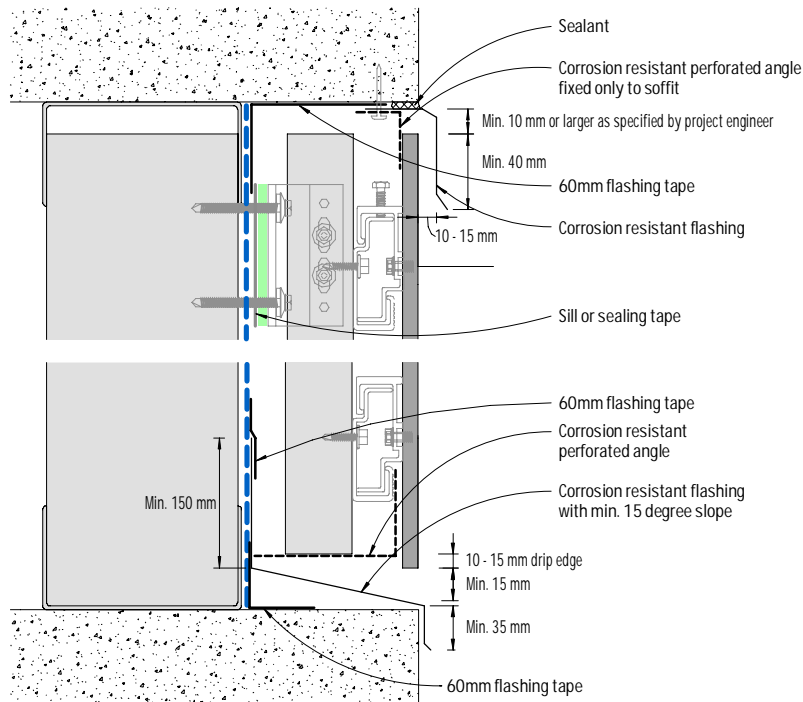


Figure 23: Exposed concrete slab or beam - Cladding flush

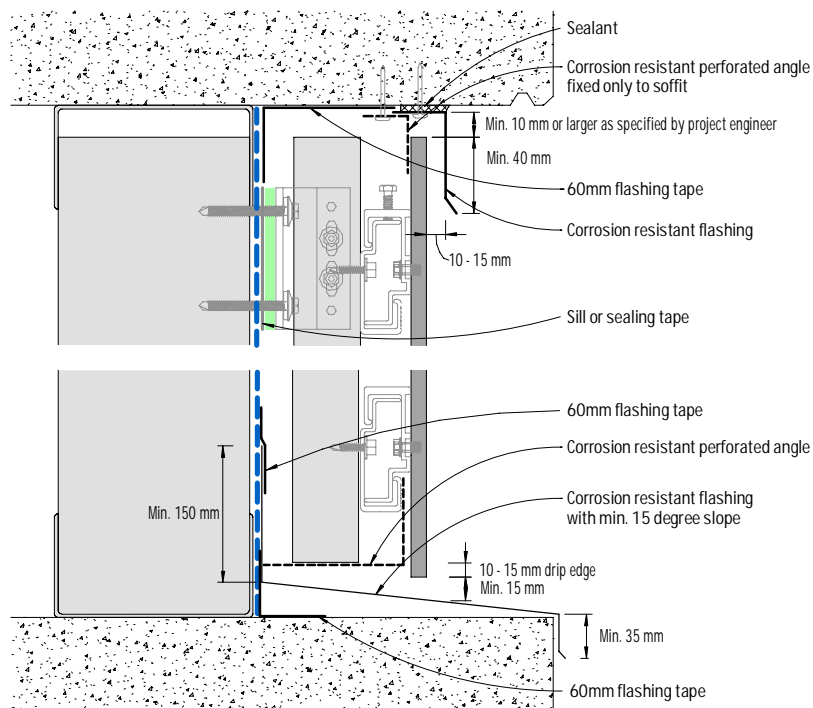


Figure 24: Exposed concrete slab or beam - Cladding recessed

Notes

- 1) Refer to Pro Clima's flashing tape application guide for any pre-treatment required on concrete or masonry for the application of the flashing tape onto these substrates.
- 2) Support frame profiles must NOT be fixed crossing over a control joint.
- 3) Corrosion resistant perforated angle shall be of max. thickness of 0.9mm where located between panel and support frame, and be of min. 50% open area with aperture size of 3-5mm.

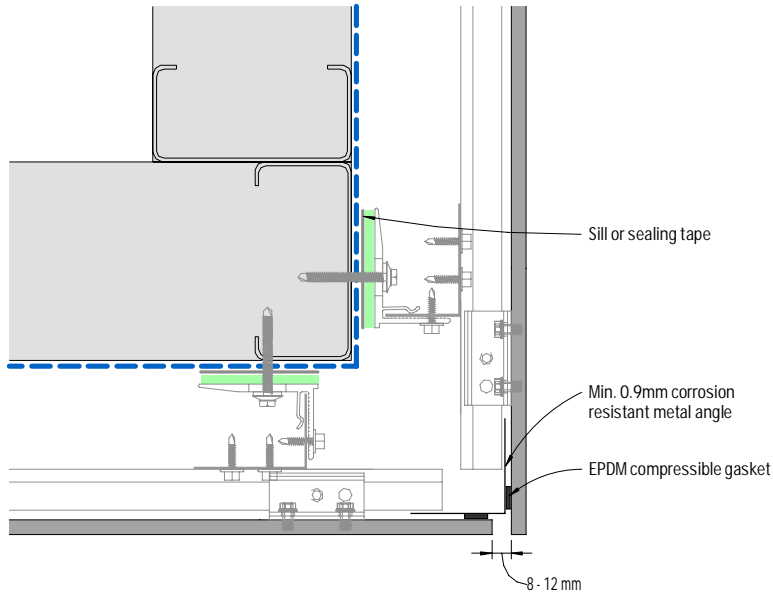


Figure 25: External corner

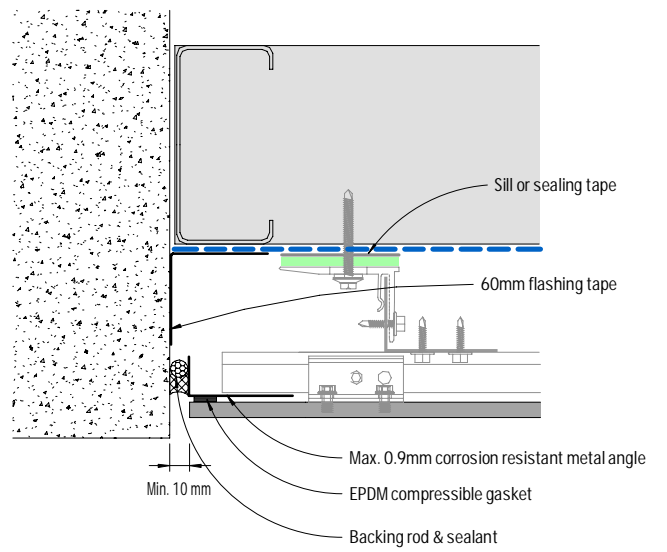


Figure 26: Abutment

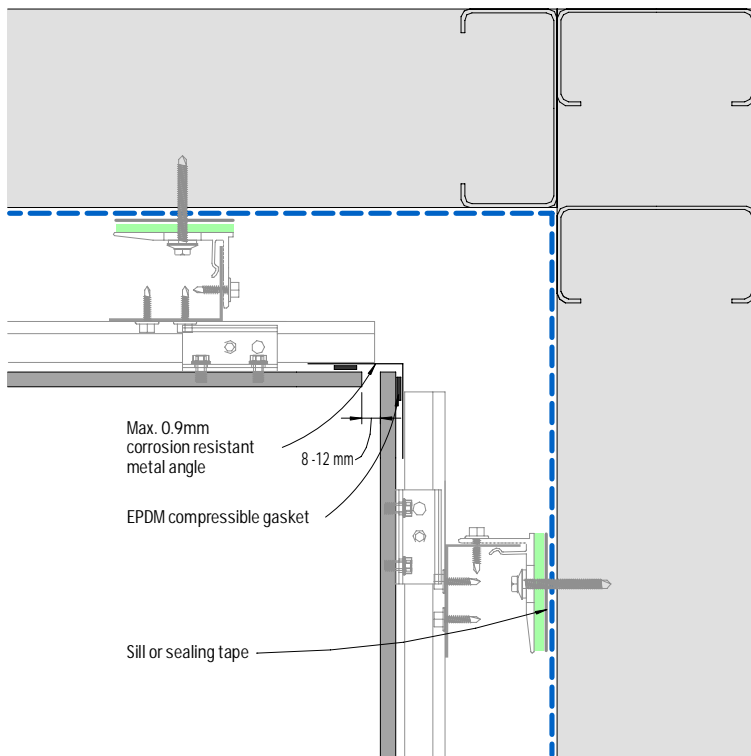


Figure 27: Internal corner

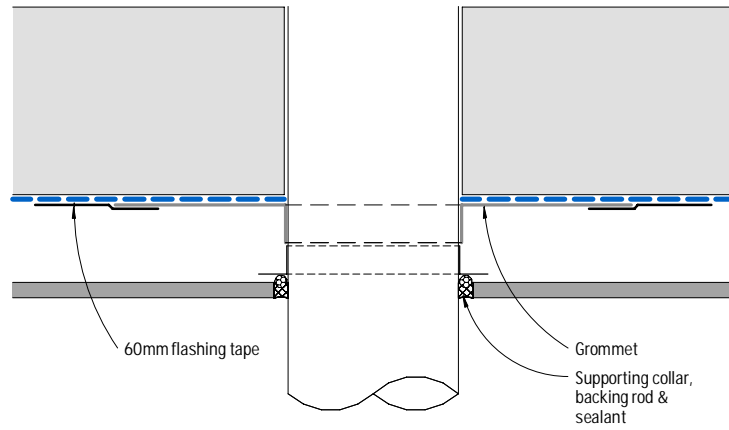


Figure 28: Pipe penetration - Plan view

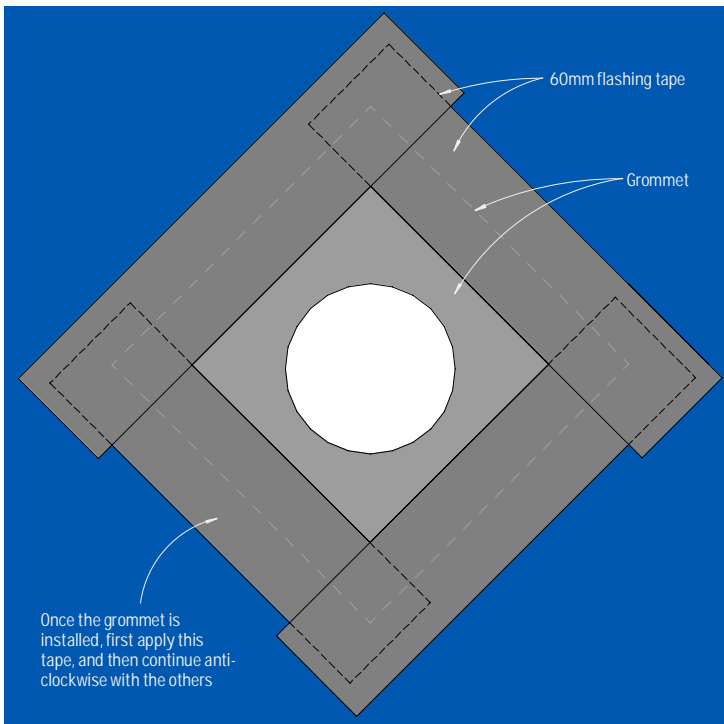


Figure 29: Pipe penetration - Elevation

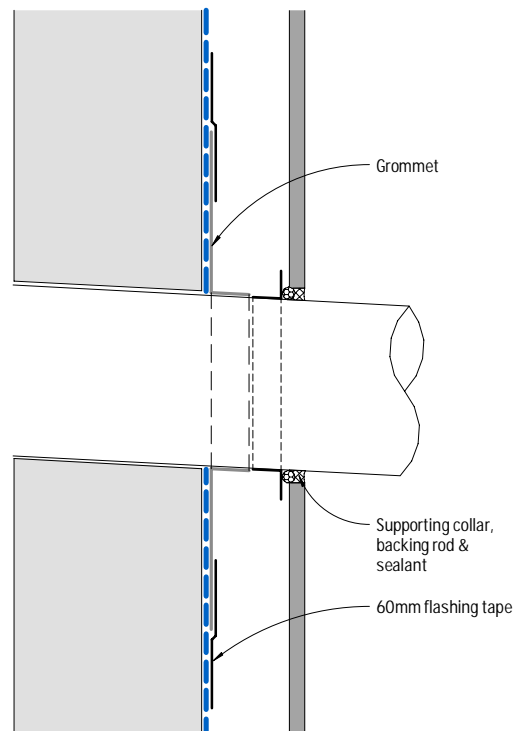


Figure 30: Pipe penetration - Section

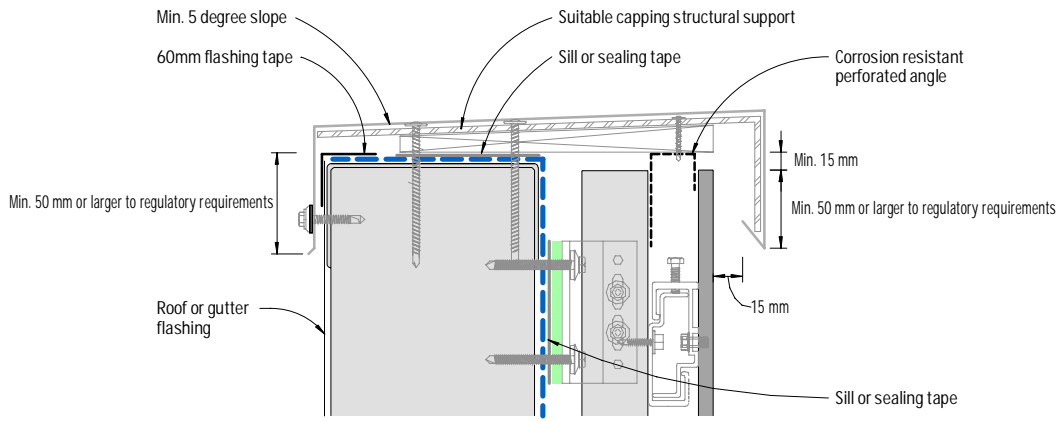


Figure 31: Capping - Detail 1

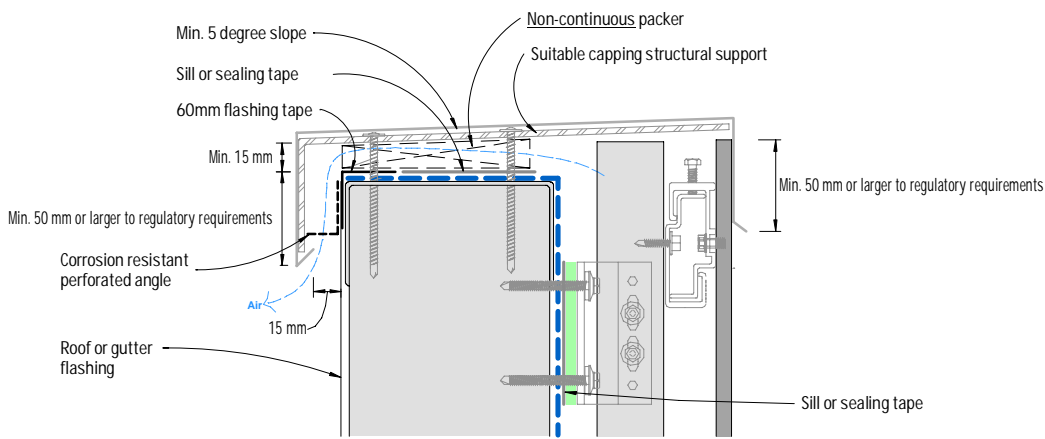


Figure 32: Capping - Detail 2  
(Not suitable for EQUITONE [material])

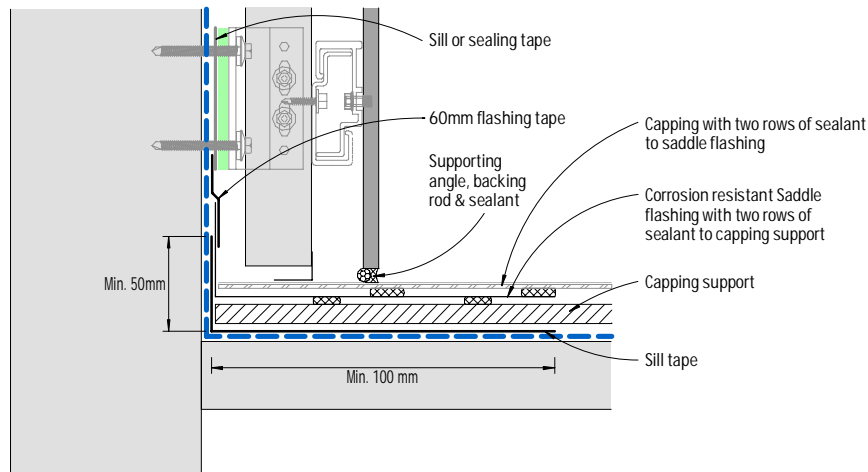


Figure 33: Parapet junction - Section

Notes

- 1) For EQUITONE [material], the following capping dimensions should be followed.
  - A minimum 20mm between panel face and rear of the capping
  - A minimum 50mm overlap with the panel for building up to 8m or larger to regulatory requirements.
  - A minimum 80mm overlap with the panel for building up to 20m or larger to regulatory requirements.
  - A minimum 100mm overlap with the panel for building over 20m or larger to regulatory requirements.
- 2) Any face fixings of capping shall be through an over sized hole (by min 5mm) in the capping as well as the panel.
- 3) Corrosion resistant perforated angle shall be of max. thickness of 0.9mm where located between panel and support frame, and be of min. 50% open area with aperture size of 3-5mm.
- 4) Capping shall be designed and engineered accordingly to provide adequate allowance for ventilation as shown in Figures 31 & 32.



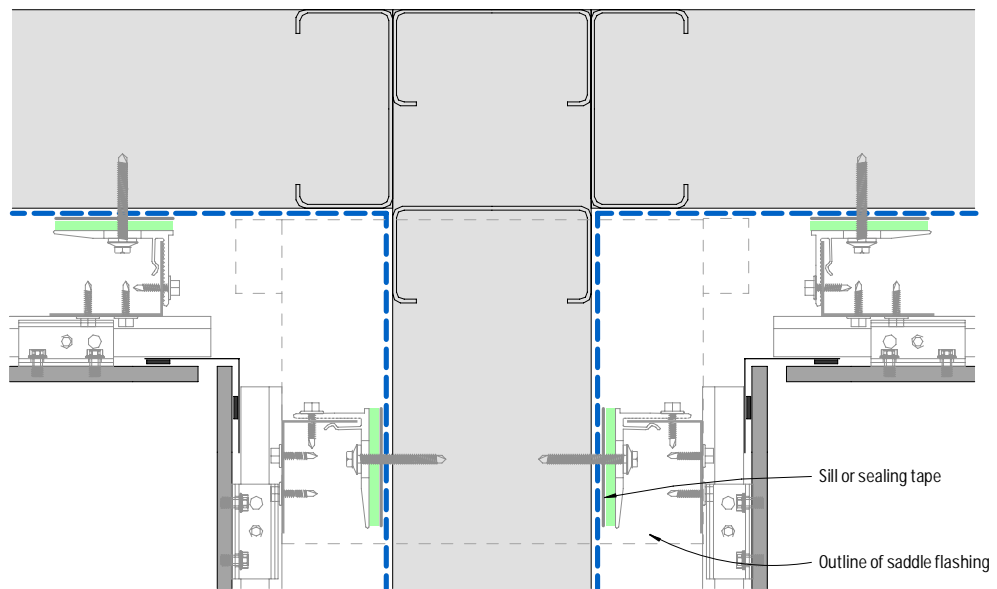


Figure 34: Parapet junction - Plan view


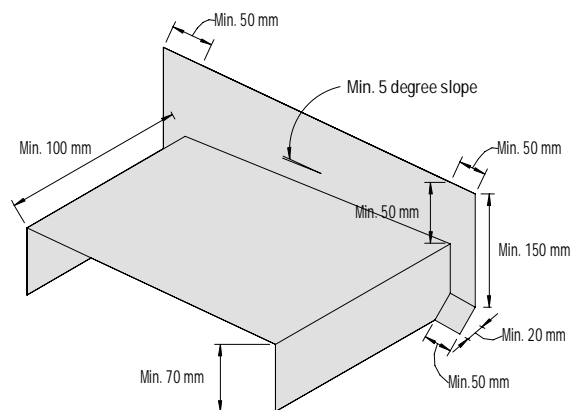


Figure 35: Corrosion resistant saddle flashing

# EQUITONE system

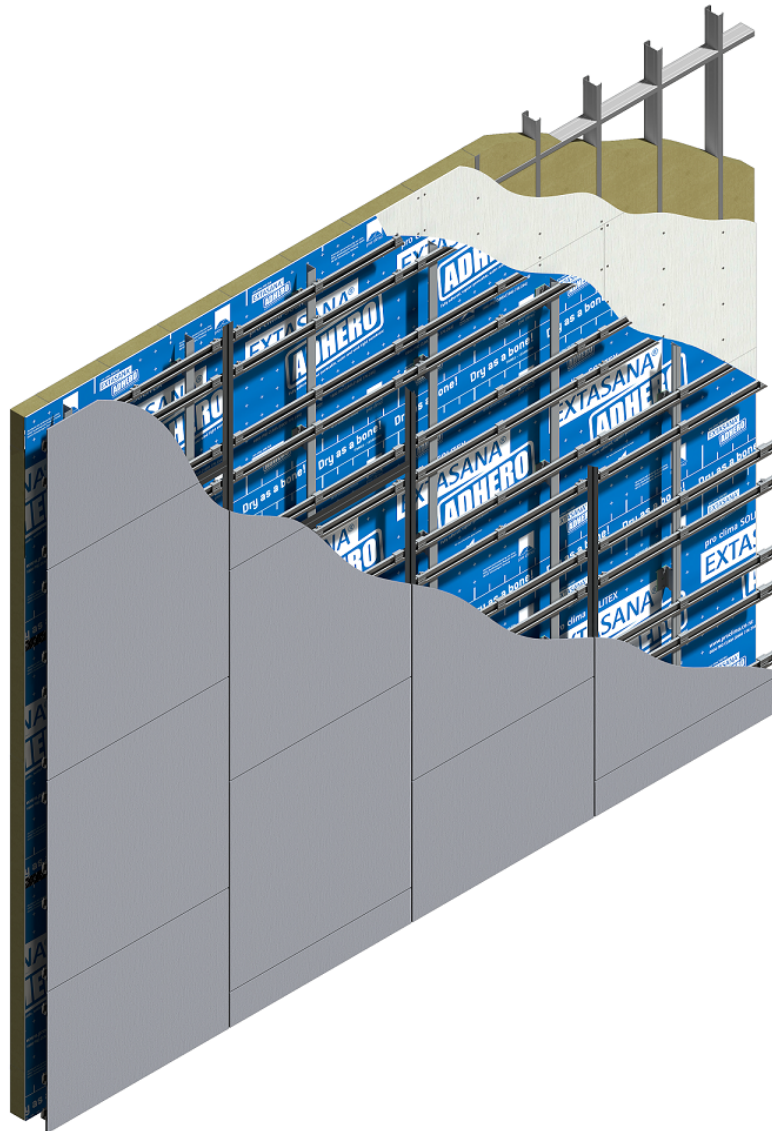

rigid air barrier  
concealed fixing system

# Drawings index

Detail	Figure	Page
Baffled horizontal joint	1	28
Baffled horizontal joint junction with vertical joint - Elevation	2	28
Open horizontal joint	3	28
Open horizontal joint junction with vertical joint - Elevation	4	28
Vertical joint - Detail 1	5	29
Vertical joint - Detail 2	6	29
Intermediate panel fixings connection	7	29
Horizontal control joint	8	30
Vertical control joint	9	30
Flush window - Head and sill	10	31
Flush window - Jamb	11	31
Recessed window - Head and sill	12	32
Recessed window jamb - Option 1	13	32
Recessed window jamb - Option 2	14	32
Meter box - Section	15	33
Meter box - Plan view - Detail 1	16	33
Meter box - Plan view - Detail 2	17	33
Isometric view of window/meter box opening - Tape application	18	34
Soffit junction	19	34
Base detail	20	35
Base detail - Covered area	21	35
Base detail - Balcony	22	35
Junction with other materials - flush detail	23	36
Junction with other materials, eaves or the like - recessed detail	24	36
Exposed concrete slab or beam - Cladding flush	25	37
Exposed concrete slab or beam - Cladding recessed	26	37
External corner	27	38
Abutment	28	38
Internal corner	29	38
Pipe penetration - Plan view	30	39
Pipe penetration - Elevation	31	39
Pipe penetration - Section	32	39
Capping - Detail 1	33	40
Capping - Detail 2	34	40
Parapet junction - Section	35	40
Parapet junction - Plan view	36	41
Corrosion resistant saddle flashing	37	41

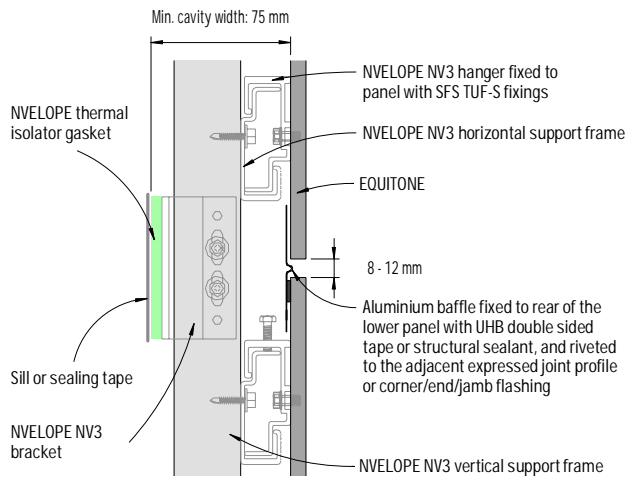


Figure 1: Baffled horizontal joint  
(Not suitable for EQUITONE [material])

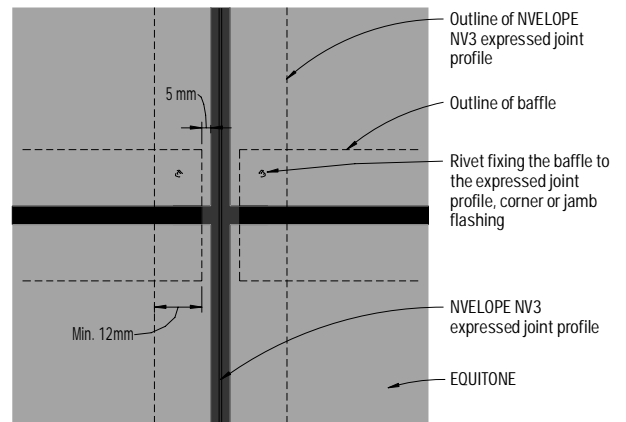


Figure 2: Baffled horizontal joint  
junction with vertical joint - Elevation

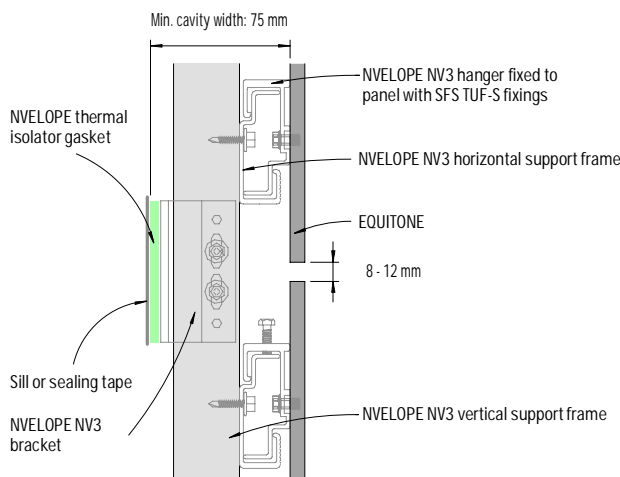


Figure 3: Open horizontal joint

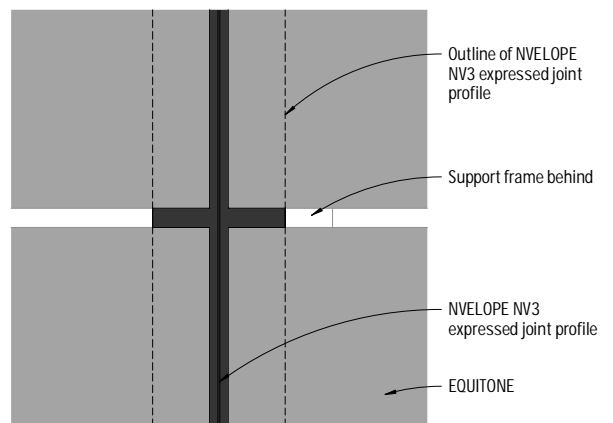


Figure 4: Open horizontal joint junction  
with vertical joint - Elevation

Notes

- 1) Horizontal open joint detail (Figure 3 & 4) requires project engineer's evaluation and approval, and the selection of appropriate UV resistant weather resistive barrier (membrane).
- 2) In Figure 4, visible part of the support frame profiles and weather barrier may be coated black with suitable paint.
- 3) The length of NVELOPE NV3 vertical and horizontal rail, and expressed joint profile must NOT exceed 3,150mm.

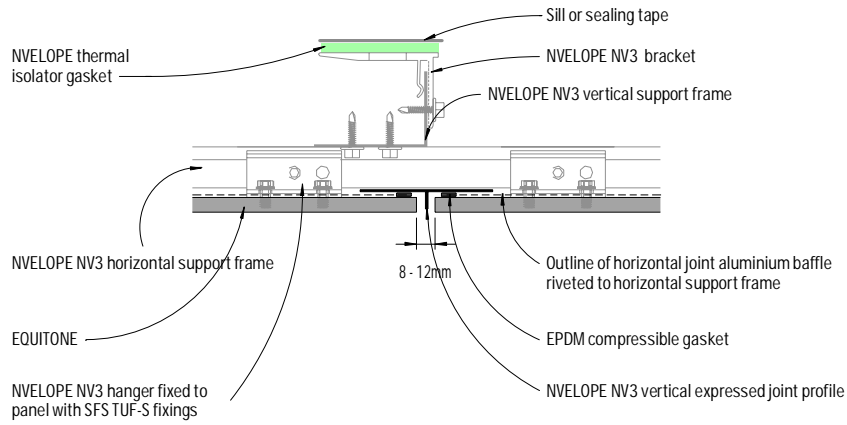


Figure 5: Vertical joint - Detail 1

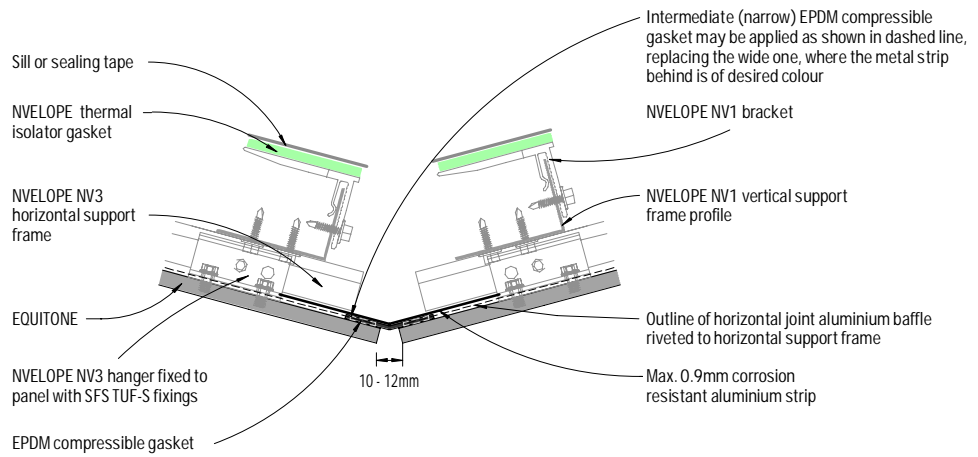


Figure 6: Vertical joint - Detail 2

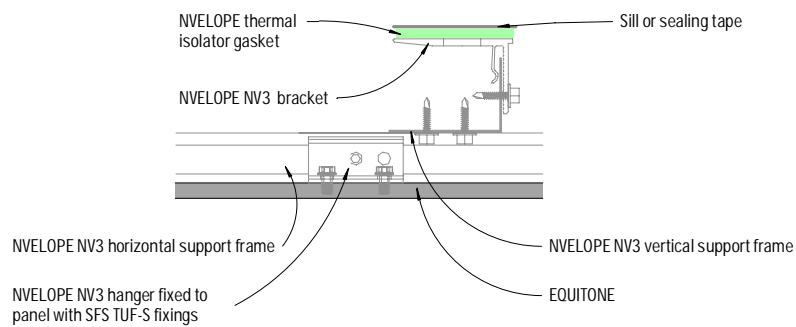


Figure 7: Intermediate panel fixings connection

Notes

- 1) The deflection of NVELOPE NV3 vertical expressed joint profile (as included in Figure 5) and any aluminium strip located at the vertical joint (as included in Figure 6) shall be limited to an extent ensuring the seal along the vertical joint is maintained with respect to project wind loading.
- 2) The aluminium strip should be fixed ONLY to one of the support frame profiles (either left or right) where allowance for horizontal and/or vertical movement of the cladding frame is required.

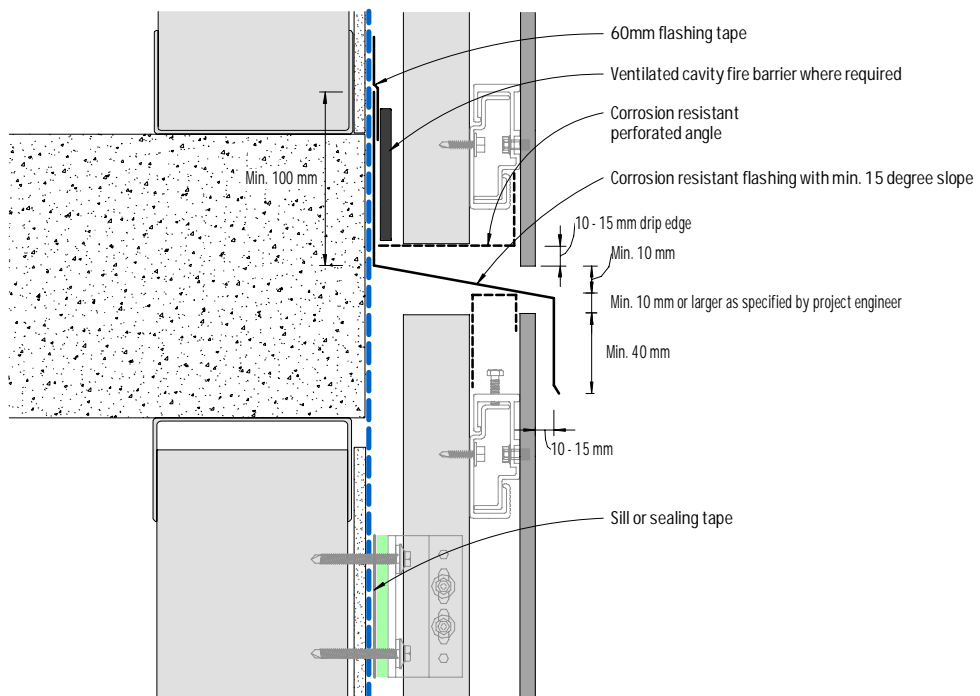


Figure 8: Horizontal control joint

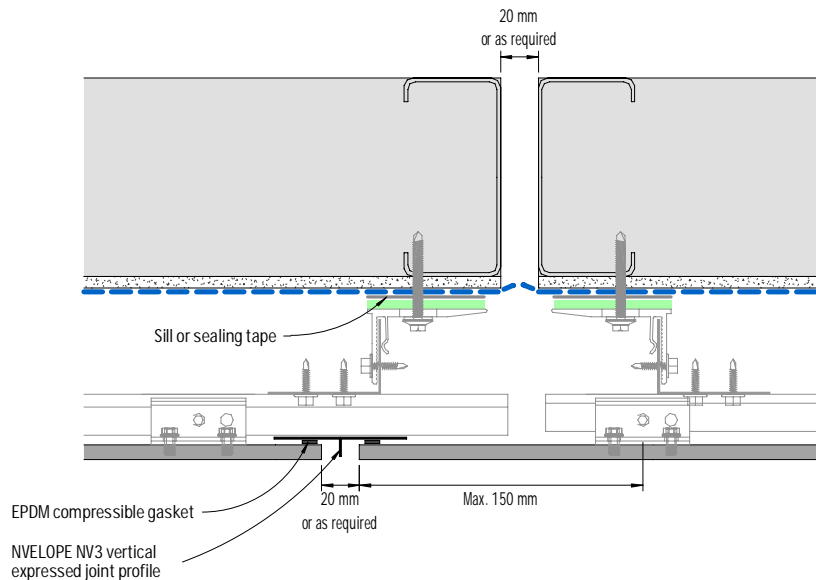


Figure 9: Vertical control joint

#### Notes

- 1) Support frame profiles and Kalsi RigidBacker must NOT be fixed crossing over a control joint.
- 2) The deflection of NVELOPE NV3 vertical expressed joint profile shall be limited to an extent ensuring the seal along the vertical joint is maintained with respect to project wind loading.
- 3) Allowance for movement at the location of any control joint must be made in the cladding and its support frame design and installation. Panel must NOT be fixed bridging over any control joint.
- 4) Corrosion resistant perforated angle shall be of max. thickness of 0.9mm where located between panel and support frame, and be of min. 50% open area with aperture size of 3-5mm.

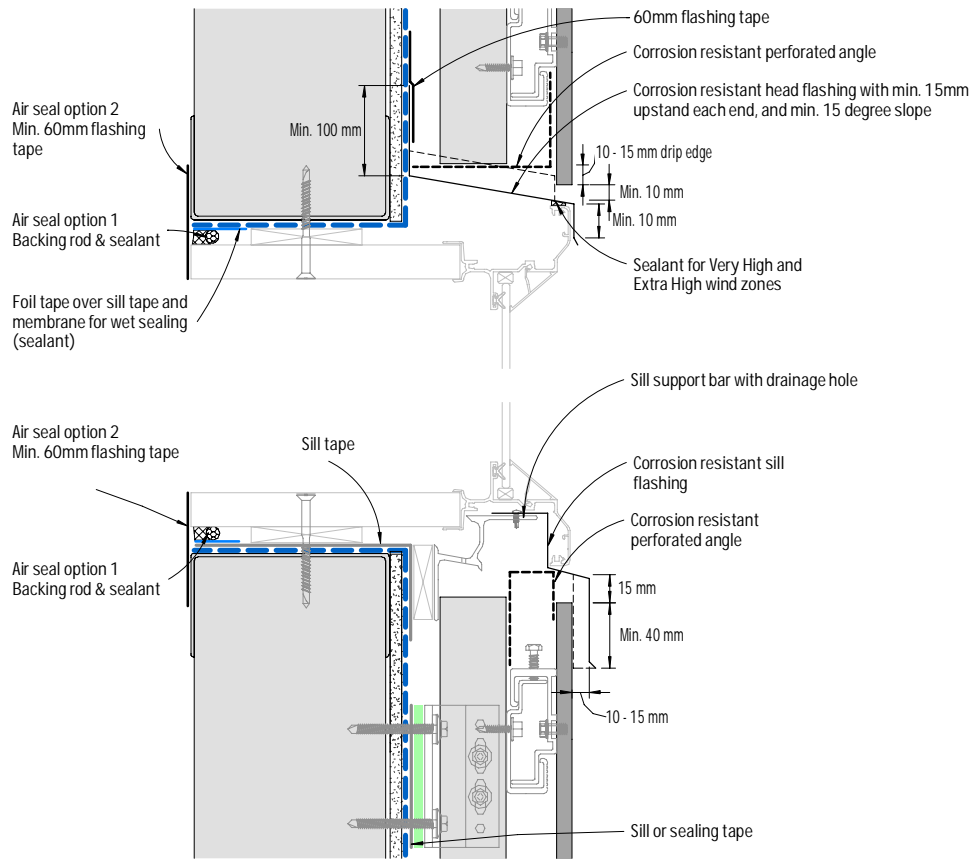


Figure 10: Flush window - Head and sill

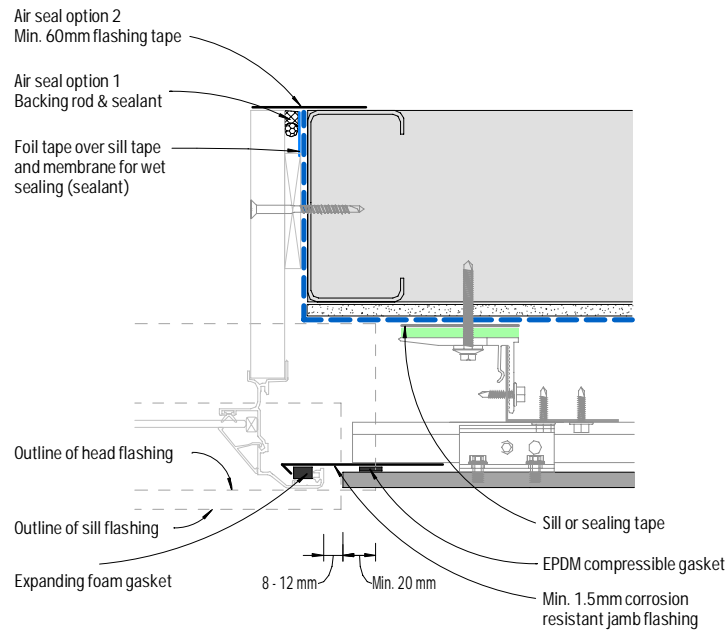


Figure 11: Flush window - Jamb

**Notes**

- 1) ONLY sealant compatible with the foil tape should be used. Should any sealant be intended to be used directly on the flashing and/or sill tape it must be confirmed with its manufacturer to ensure compatibility with these tapes in accordance with the relevant standards.
- 2) Corrosion resistant perforated angle shall be of max. thickness of 0.9mm where located between panel and support frame, and be of min. 50% open area with aperture size of 3-5mm.

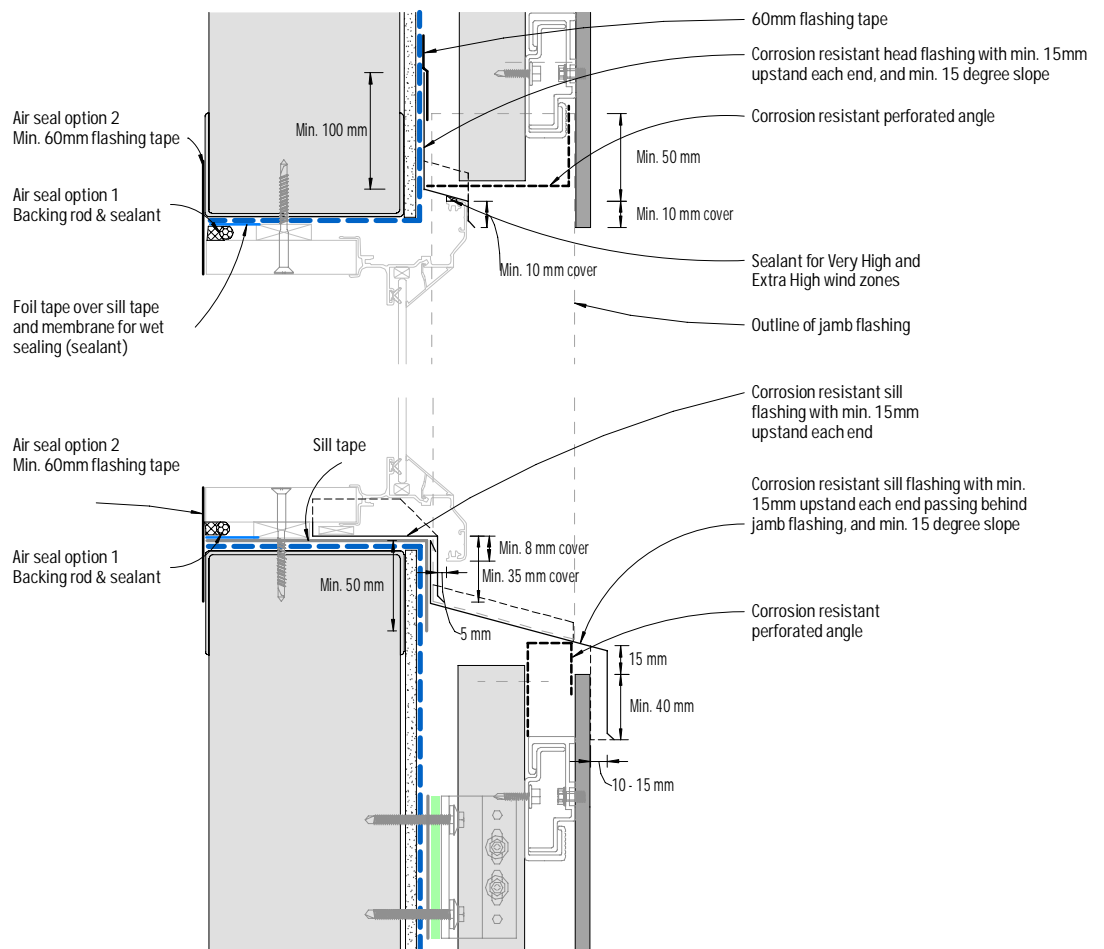


Figure 12: Recessed window - Head and sill

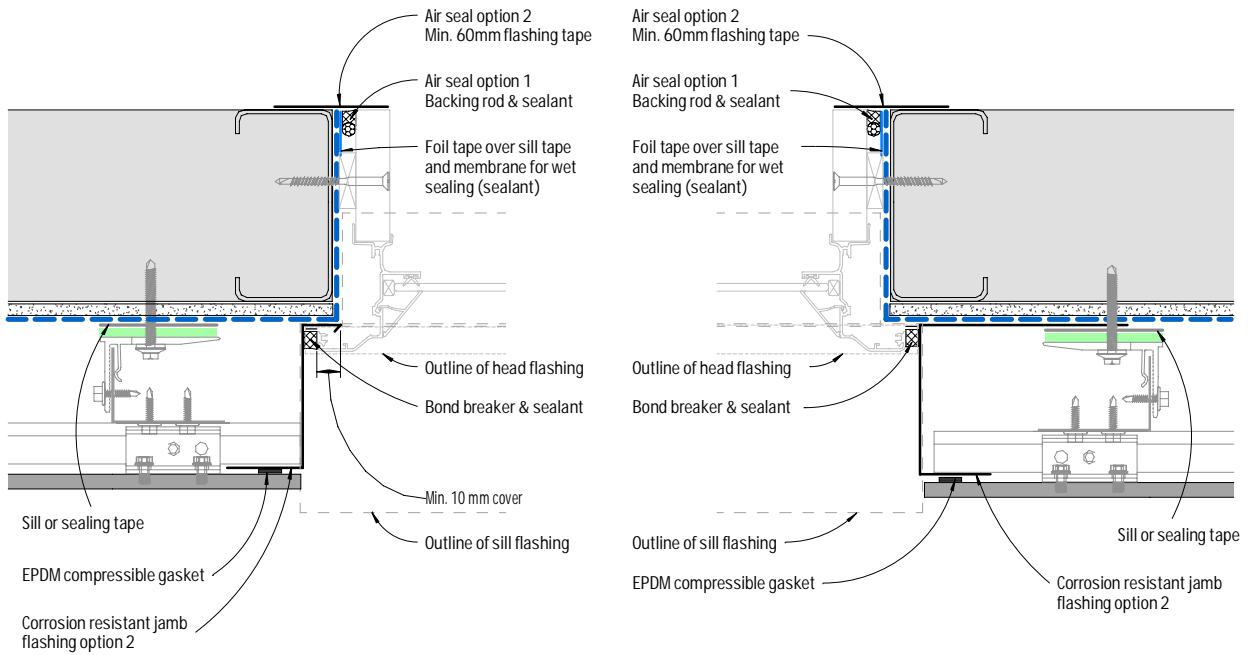


Figure 13: Recessed window jamb - Option 1

Figure 14: Recessed window jamb - Option 2

Notes

- 1) ONLY sealant compatible with the foil tape should be used. Should any sealant be intended to be used directly on the flashing and/or sill tape it must be confirmed with its manufacturer to ensure compatibility with these tapes in accordance with the relevant standards.
- 2) Corrosion resistant perforated angle shall be of max. thickness of 0.9mm where located between panel and support frame, and be of min. 50% open area with aperture size of 3-5mm.



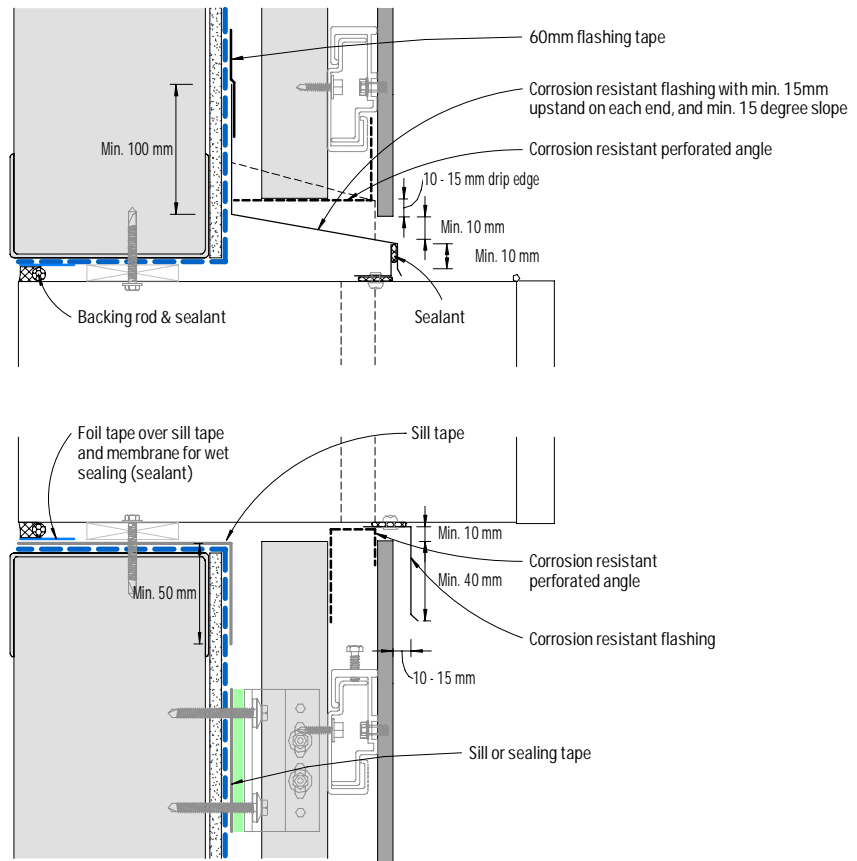


Figure 15: Meter box - Section

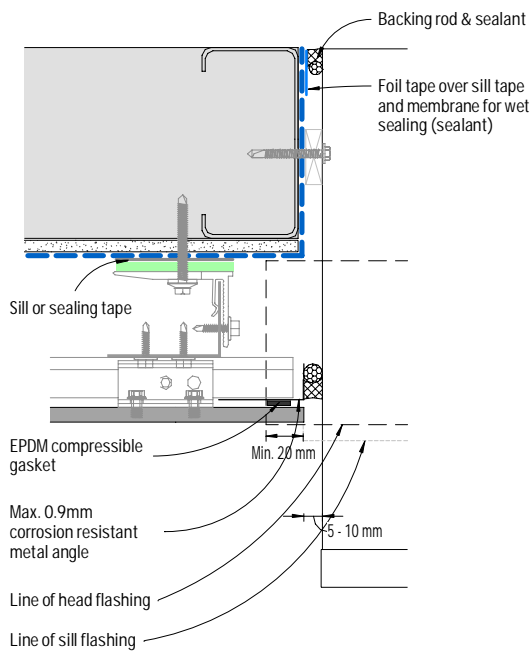


Figure 16: Meter box - Plan view - Detail 1

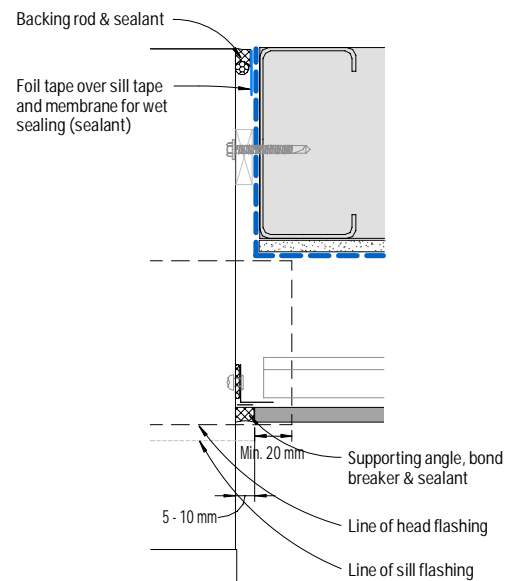


Figure 17: Meter box - Plan view - Detail 2

Notes

- 1) ONLY sealant compatible with the foil tape should be used. Should any sealant be intended to be used directly on the flashing and/or sill tape it must be confirmed with its manufacturer to ensure compatibility with these tapes in accordance with the relevant standards.
- 2) Corrosion resistant perforated angle shall be of max. thickness of 0.9mm where located between panel and support frame, and be of min. 50% open area with aperture size of 3-5mm.

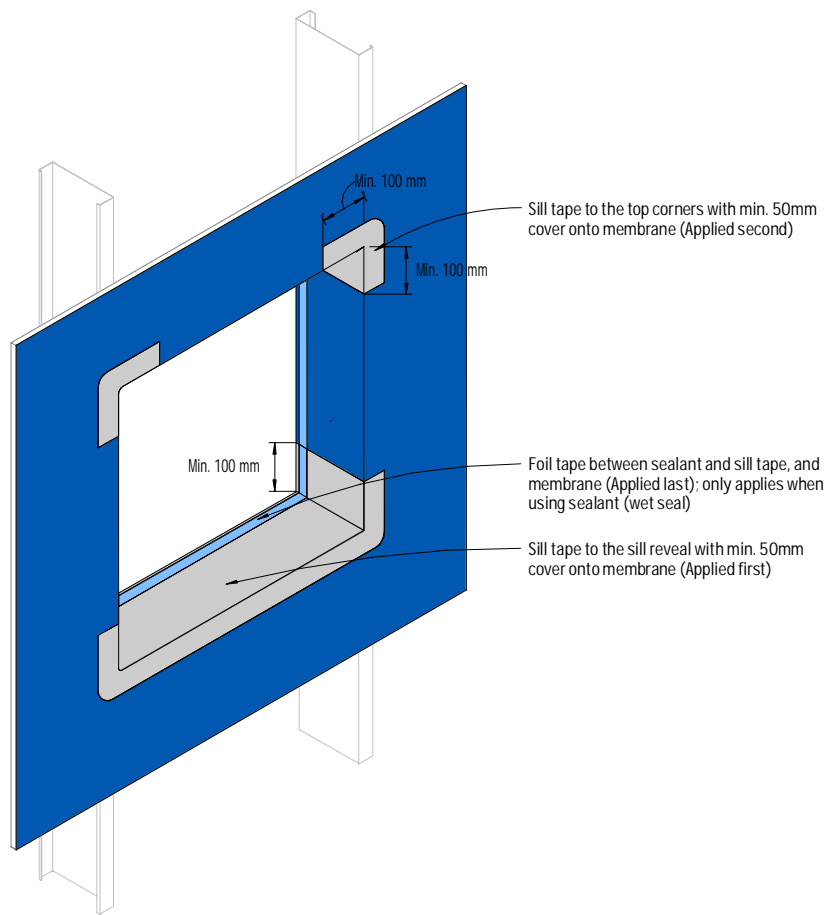


Figure 18: Isometric view of window/meter box opening - Tape application

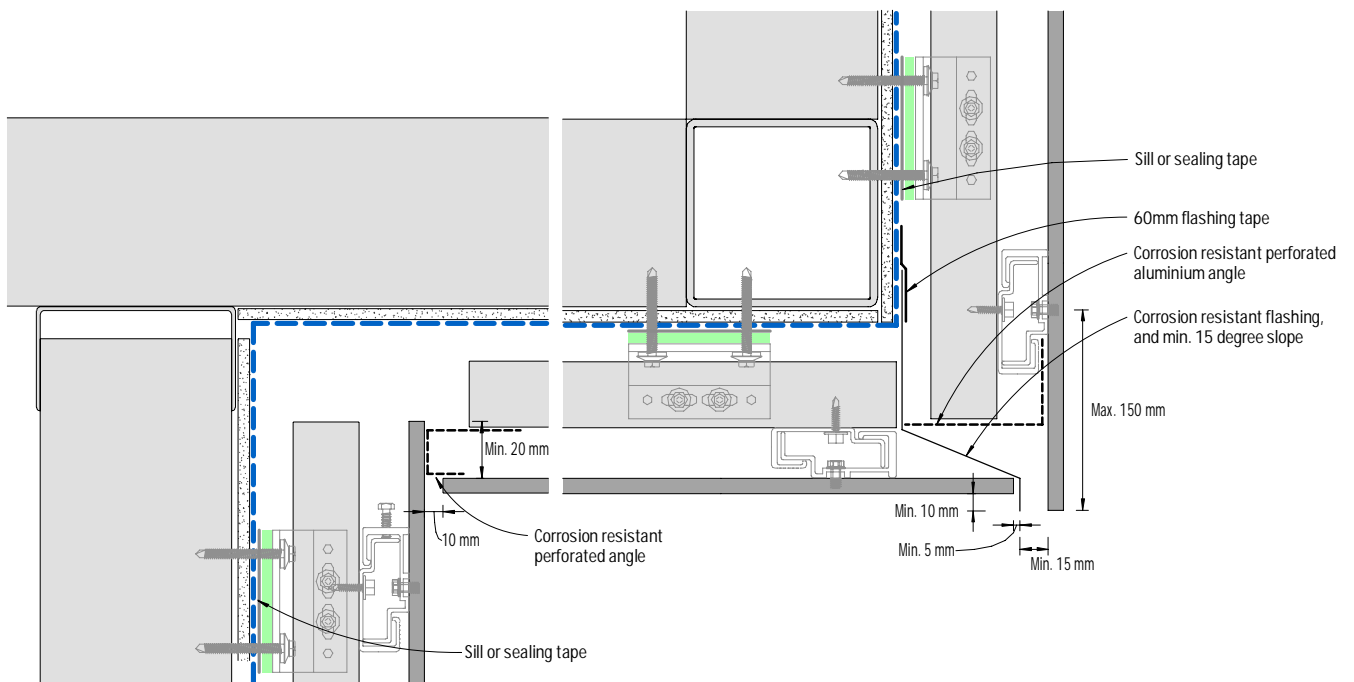


Figure 19: Soffit junction

Notes

- 1) ONLY sealant compatible with the foil tape should be used. Should any sealant be intended to be used directly on the flashing and/or sill tape it must be confirmed with its manufacturer to ensure compatibility with these tapes in accordance with the relevant standards.
- 2) Support frame profiles and Kalsi RigidBacker must NOT be fixed crossing over a control joint.
- 3) Corrosion resistant perforated angle shall be of max. thickness of 0.9mm where located between panel and support frame, and be of min. 50% open area with aperture size of 3-5mm.

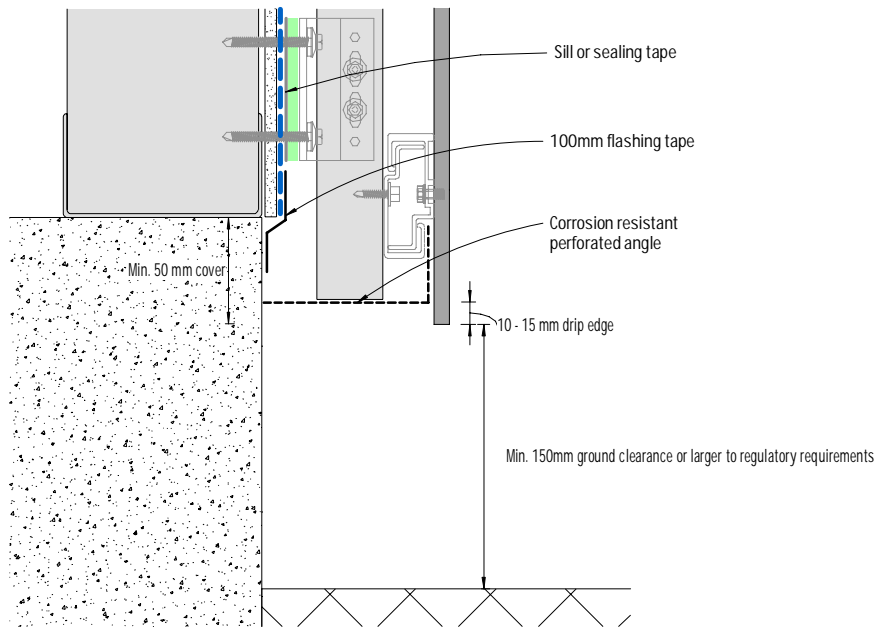


Figure 20: Base detail

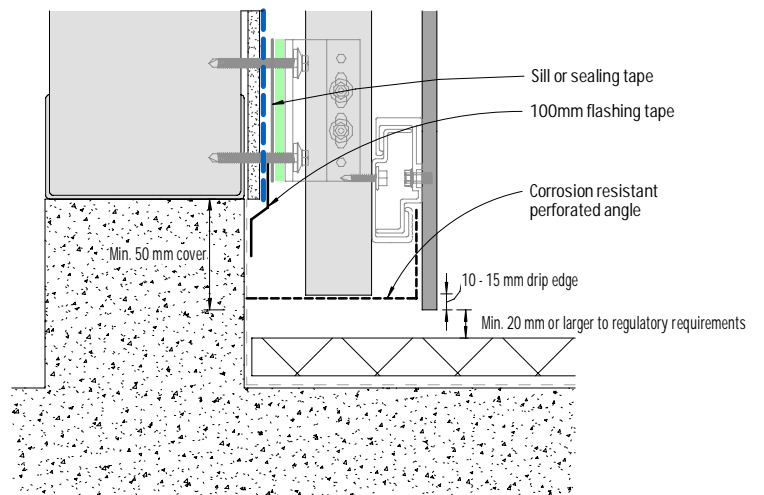


Figure 21: Base detail - Covered area

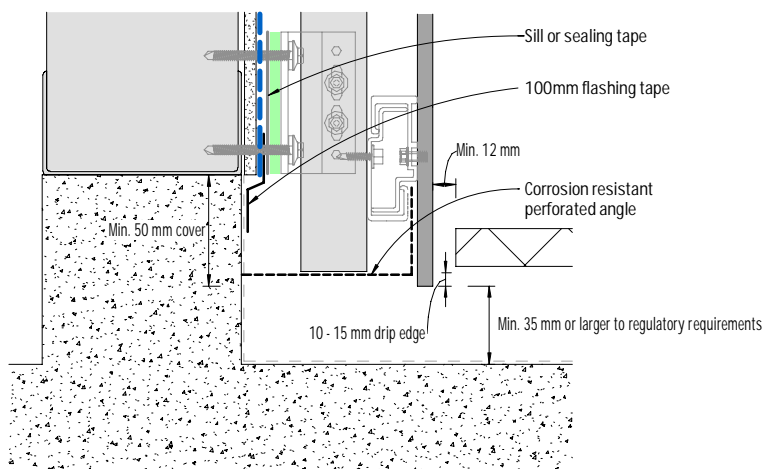


Figure 22: Base detail - Balcony

Notes

1) For **EQUITONE [materia]**, minimum ground clearance is **300mm**.

2) Corrosion resistant perforated angle shall be of max. thickness of 0.9mm where located between panel and support frame, and be of min. 50% open area with aperture size of 3-5mm.

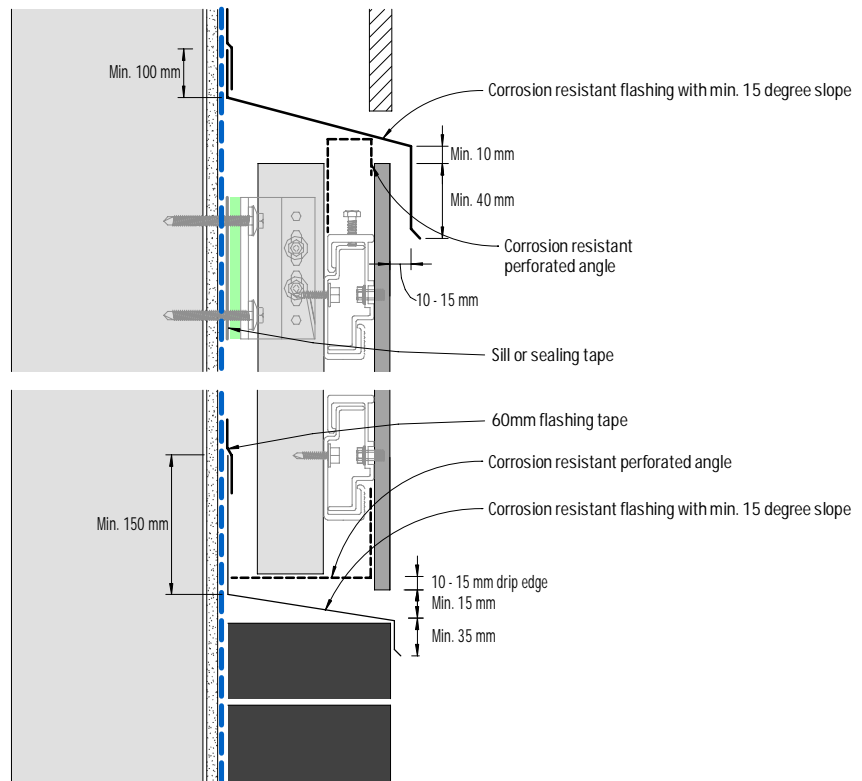


Figure 23: Junction with other materials - flush detail

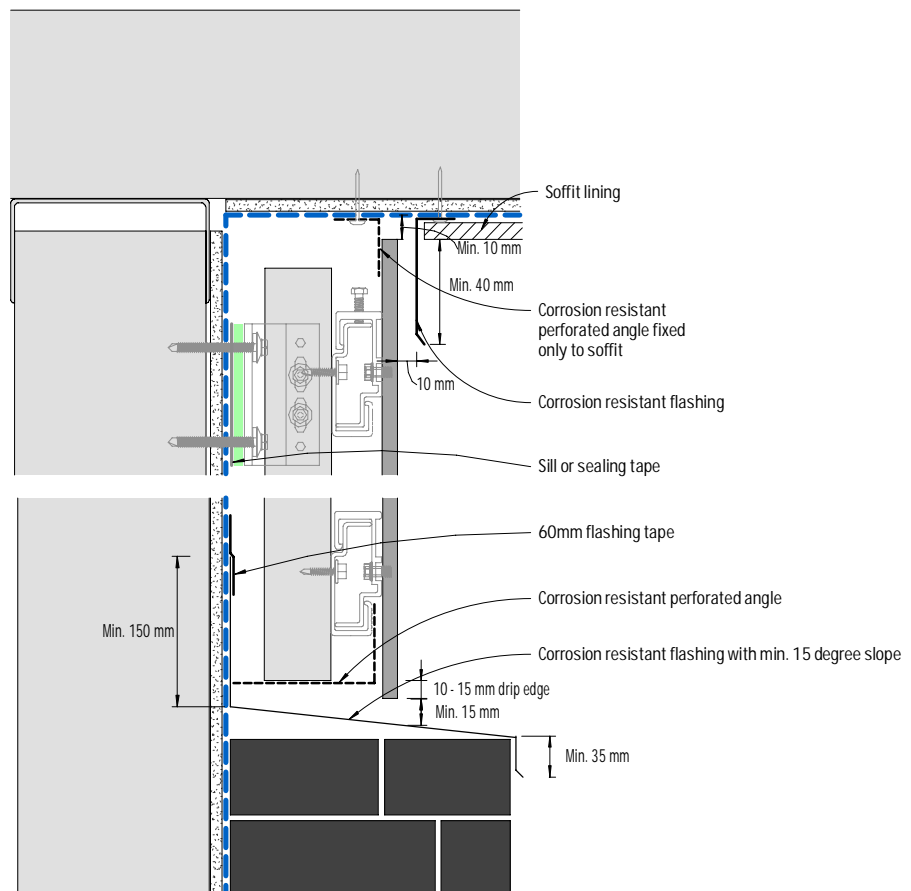


Figure 24: Junction with other materials, eaves or the like - recessed detail

Notes

- 1) Support frame profiles and Kalsi RigidBacker must NOT be fixed crossing over a control joint.
- 2) Corrosion resistant perforated angle shall be of max. thickness of 0.9mm where located between panel and support frame, and be of min. 50% open area with aperture size of 3-5mm.

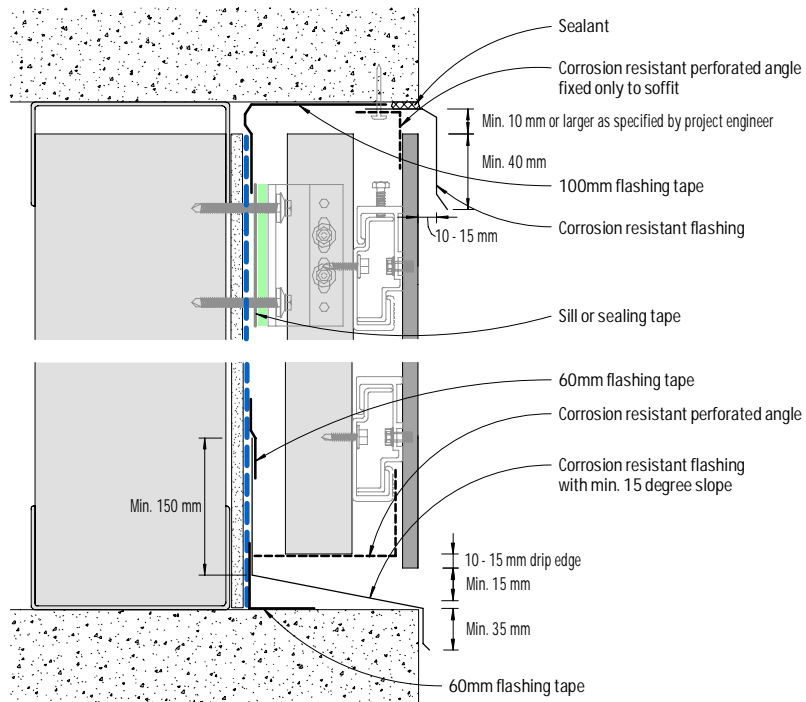


Figure 25: Exposed concrete slab or beam - Cladding flush

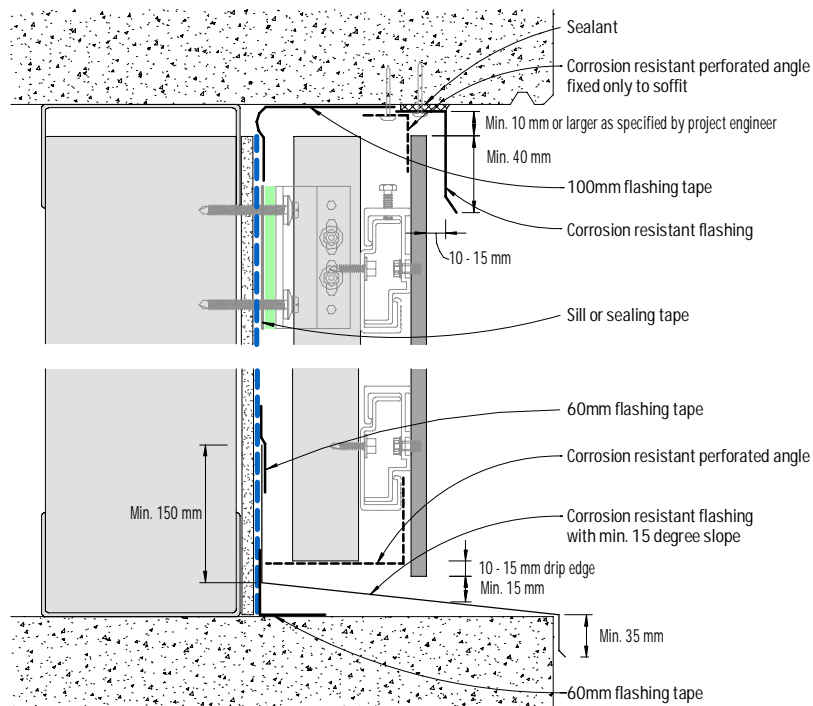


Figure 26: Exposed concrete slab or beam - Cladding recessed

Notes

- 1) Refer to Pro Clima's flashing tape application guide for any pre-treatment required on concrete or masonry for the application of the flashing tape onto these substrates.
- 2) Support frame profiles and Kalsi RigidBacker must NOT be fixed crossing over a control joint.
- 3) Corrosion resistant perforated angle shall be of max. thickness of 0.9mm where located between panel and support frame, and be of min. 50% open area with aperture size of 3-5mm.

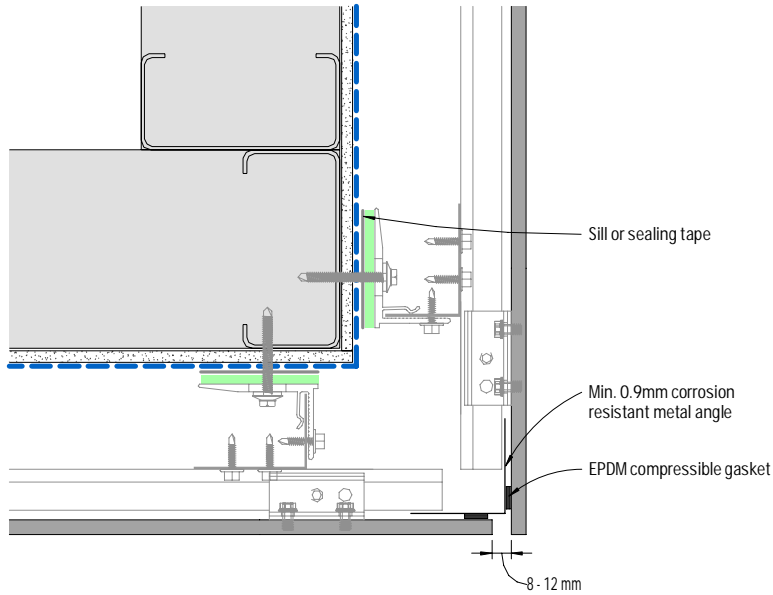


Figure 27: External corner

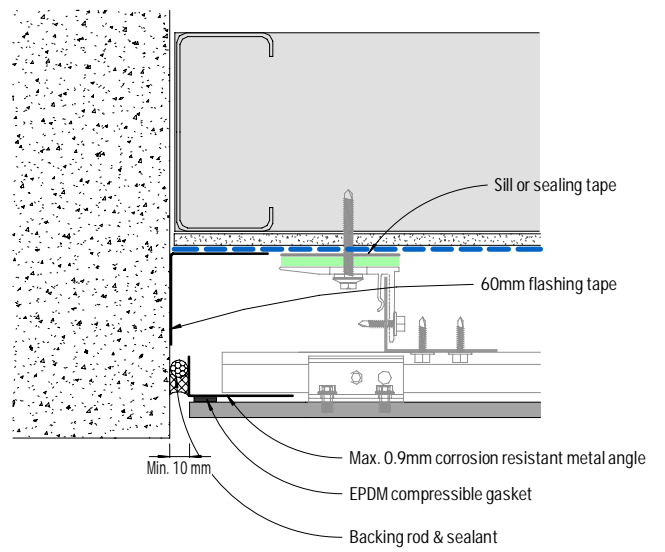


Figure 28: Abutment

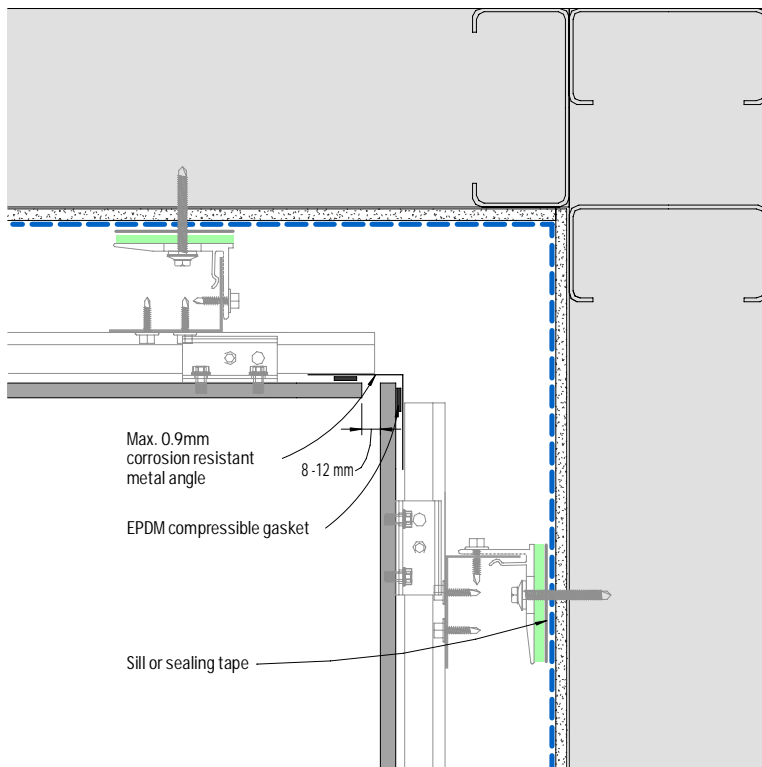


Figure 29: Internal corner

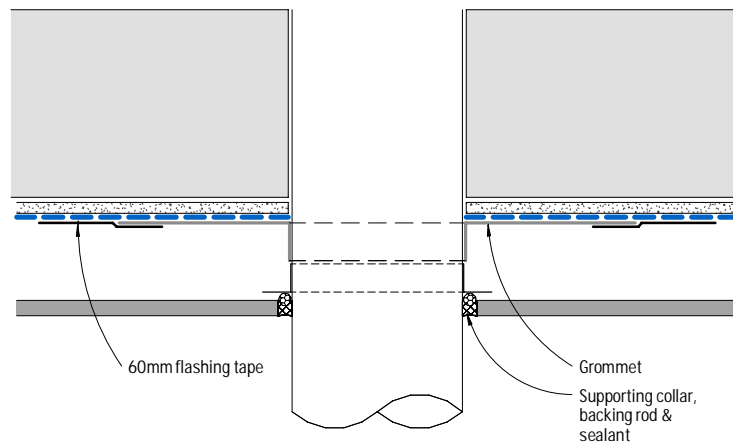


Figure 30: Pipe penetration - Plan view

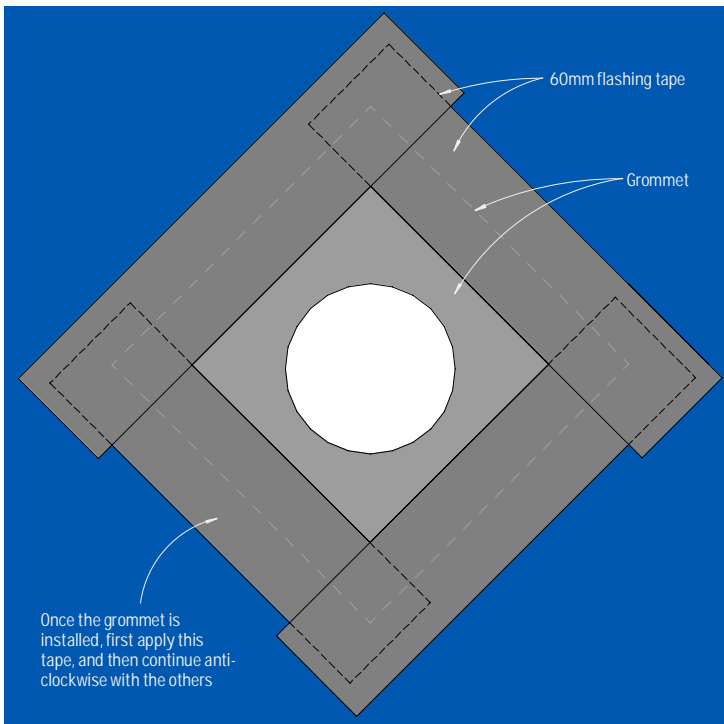


Figure 31: Pipe penetration - Elevation

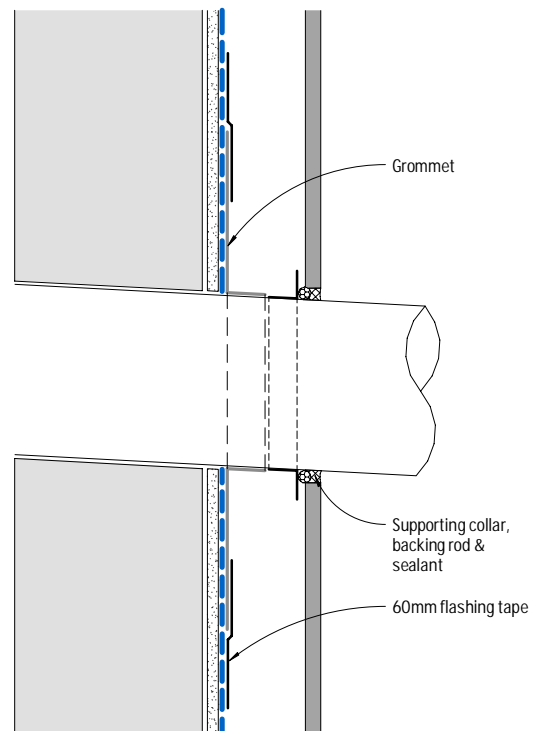


Figure 32: Pipe penetration - Section

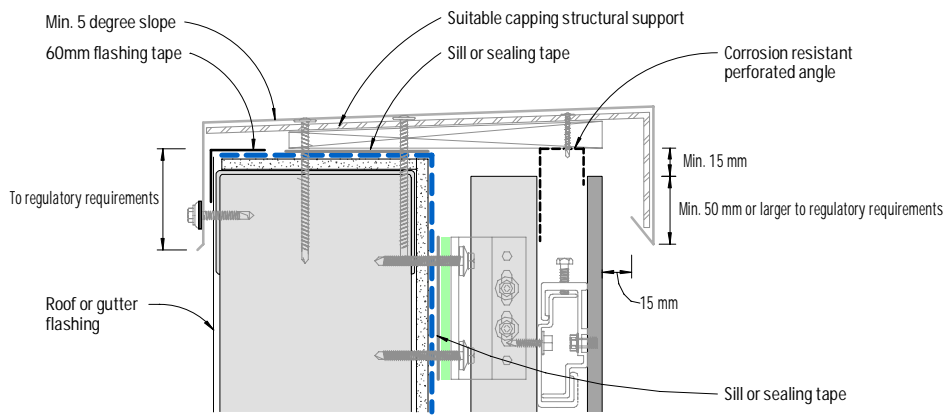


Figure 33: Capping - Detail 1

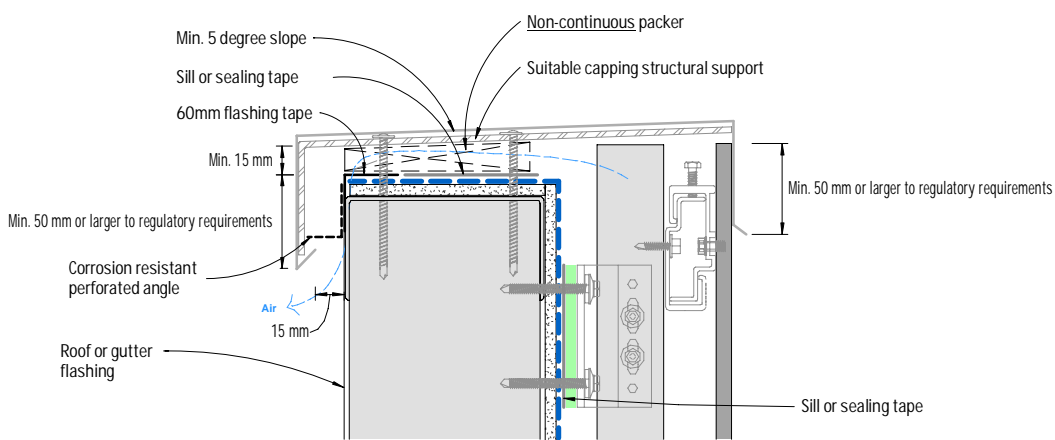


Figure 34: Capping - Detail 2  
(Not suitable for EQUITONE [material])

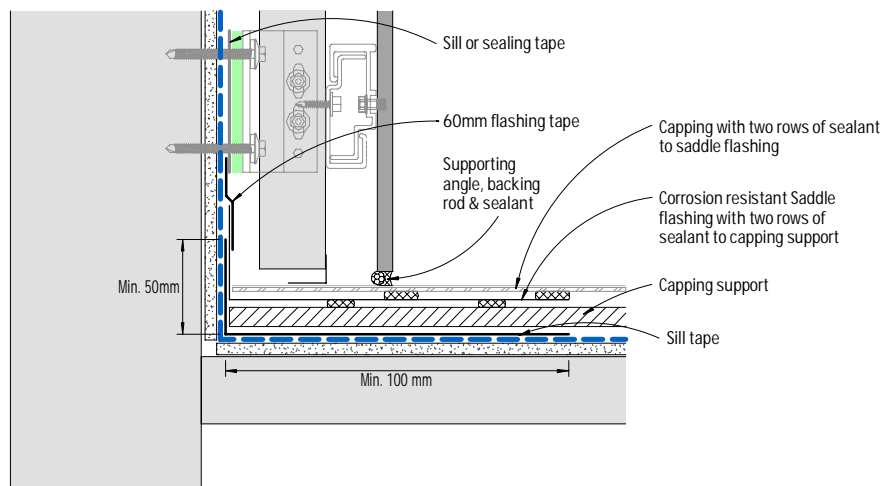


Figure 35: Parapet junction - Section

Notes

- 1) For EQUITONE [material], the following capping dimensions should be followed.
  - A minimum 20mm between panel face and rear of the capping
  - A minimum 50mm overlap with the panel for building up to 8m or larger to regulatory requirements.
  - A minimum 80mm overlap with the panel for building up to 20m or larger to regulatory requirements.
  - A minimum 100mm overlap with the panel for building over 20m or larger to regulatory requirements.
- 2) Any face fixings of capping shall be through an over sized hole (by min 5mm) in the capping as well as the panel.
- 3) Corrosion resistant perforated angle shall be of max. thickness of 0.9mm where located between panel and support frame, and be of min. 50% open area with aperture size of 3-5mm.
- 4) Capping shall be designed and engineered accordingly to provide adequate allowance for ventilation as shown in Figures 33 & 34.



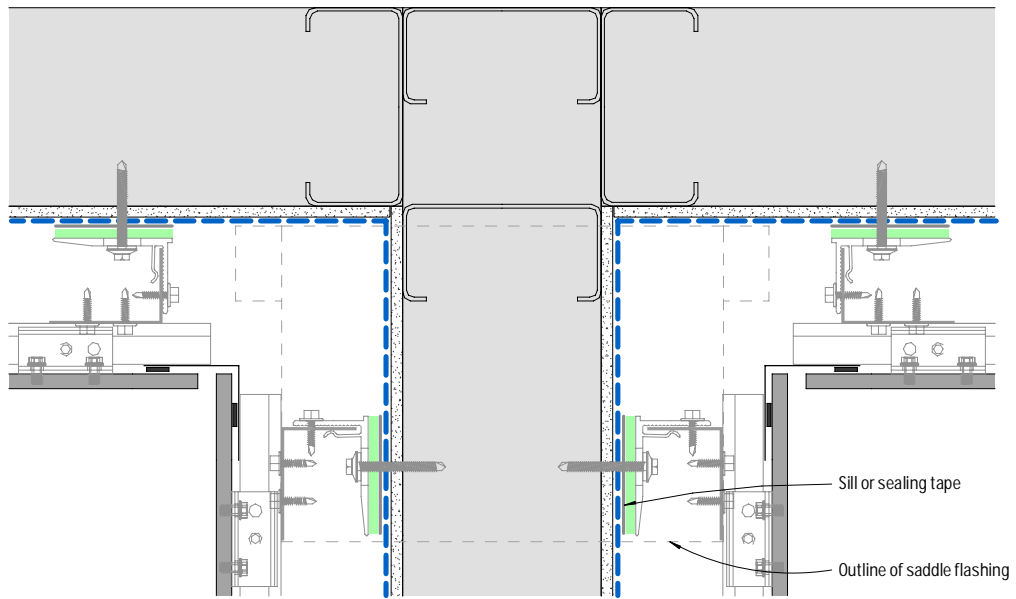


Figure 36: Parapet junction - Plan view

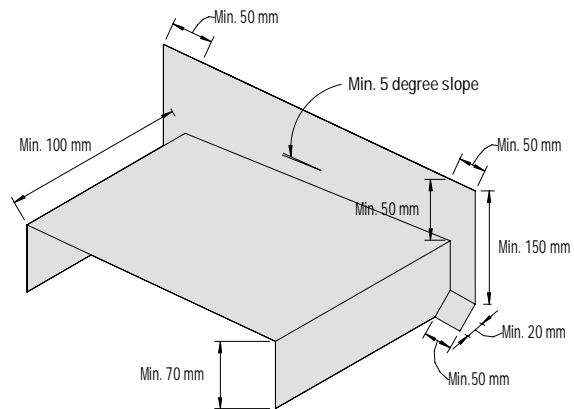


Figure 37: Corrosion resistant saddle flashing

The logo for EQUITONE system features a stylized icon of three horizontal bars of varying lengths on the left, followed by the word "EQUITONE" in a bold, uppercase, sans-serif font, and the word "system" in a lowercase, sans-serif font to its right.

Etex Exteriors ANZ  
Suite 201  
198 Harbour Esplanade  
Docklands VIC 3008  
Australia

+61 (03) 9988 2290  
[info.australia@equitone.com](mailto:info.australia@equitone.com)  
[equitone.com](http://equitone.com)